

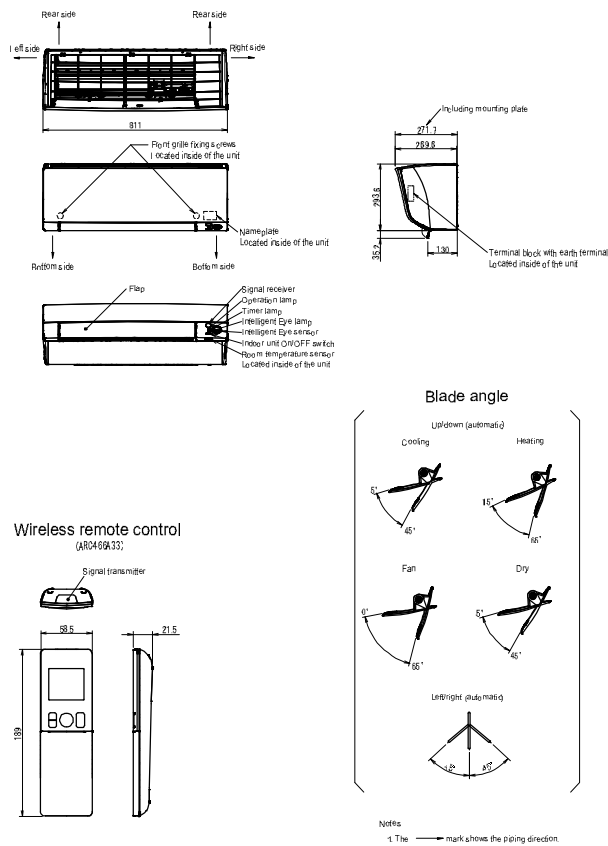


4 - 1 Dimensional Drawings


FTXM20-42M

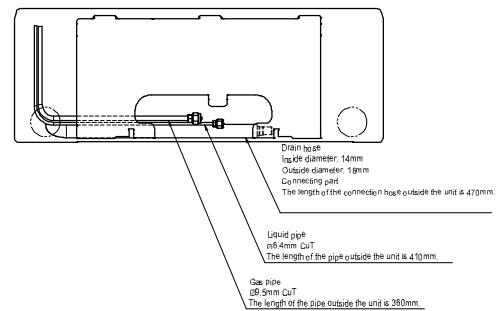

Required space for service and ventilation

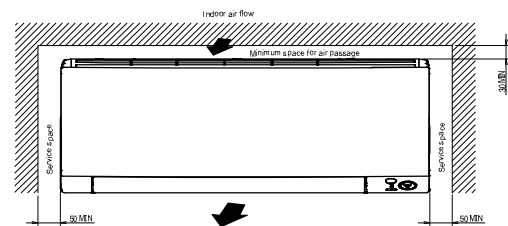


Standard location of holes in the wall

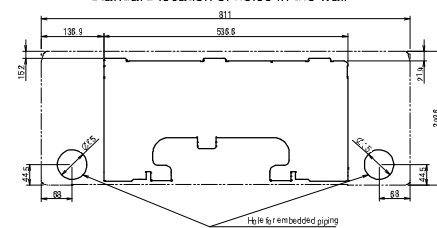


2D100063B

FTXM50-60M


The mark shows the piping direction.

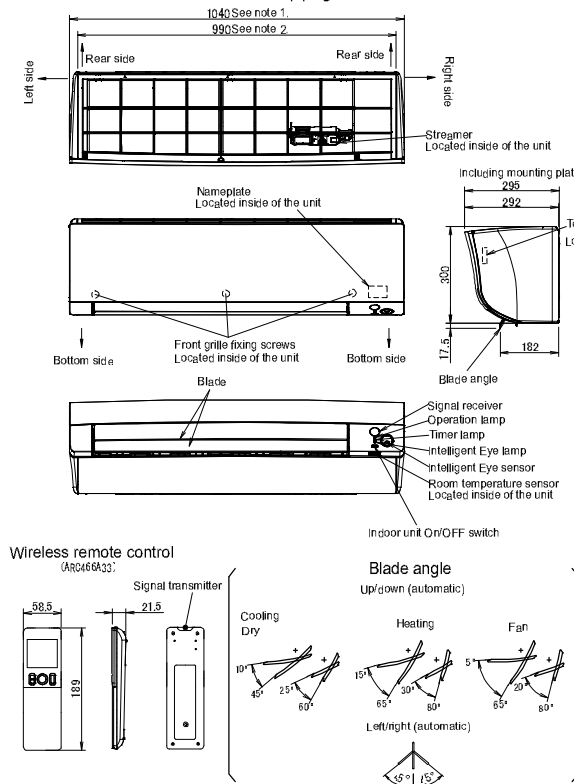


indoor air flow

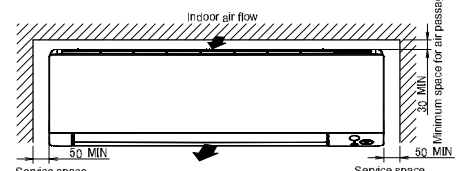

Required space for service and ventilation

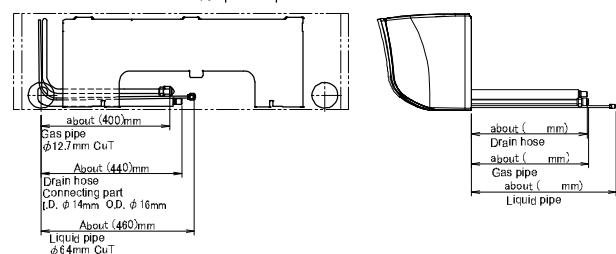

Standard location of holes in the wall

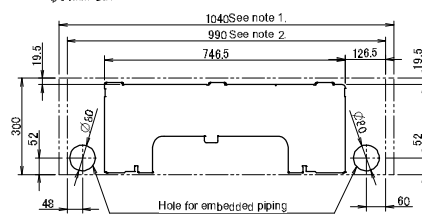

Notes

1. Total width of unit
2. Width of unit against the wall

3D101370B