


TECHNICAL DATA

Gas Heat Pump Chiller M1 Water Heat Exchanger Unit

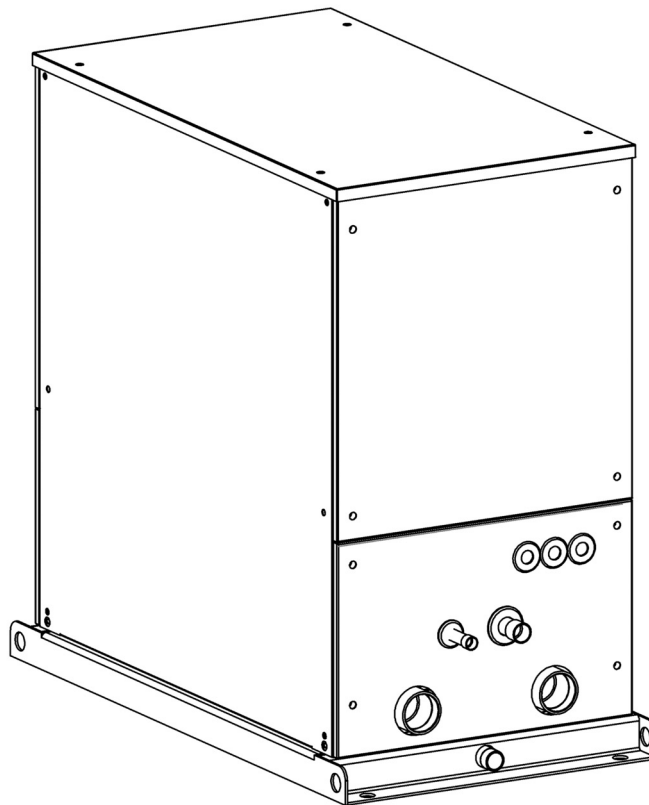


OUTDOOR MODEL No.	PRODUCT CODE No.
SGP-WE80M1	182680142
SGP-WE170M1	182680141

Contents

1. Product configuration	
(1) Connection points	A-2
2. System characteristics	A-3
3. External view	A-4
4. Specifications	
(1) Specification tables	A-5
(2) External dimension diagram	A-8
(3) Heating and cooling temperature ranges	A-9
5. Control system	
(1) System block diagram	A-10
(2) Circuit board controls and connectors	A-12
(3) Electrical wiring diagram	A-13
(4) Fault indicators and codes	A-14
6. Installation considerations	A-15
7. Electrical installation	
(1) Cable capacity	A-24
(2) Electrical connection diagram	A-25
(3) Precautions regarding electrical work	A-26
8. Center of gravity and earthquake resistance	
(1) Installation and center of gravity	A-27

(1) Connection points

Outdoor unit, water heat exchanger unit, remote control, power cable, operation cable

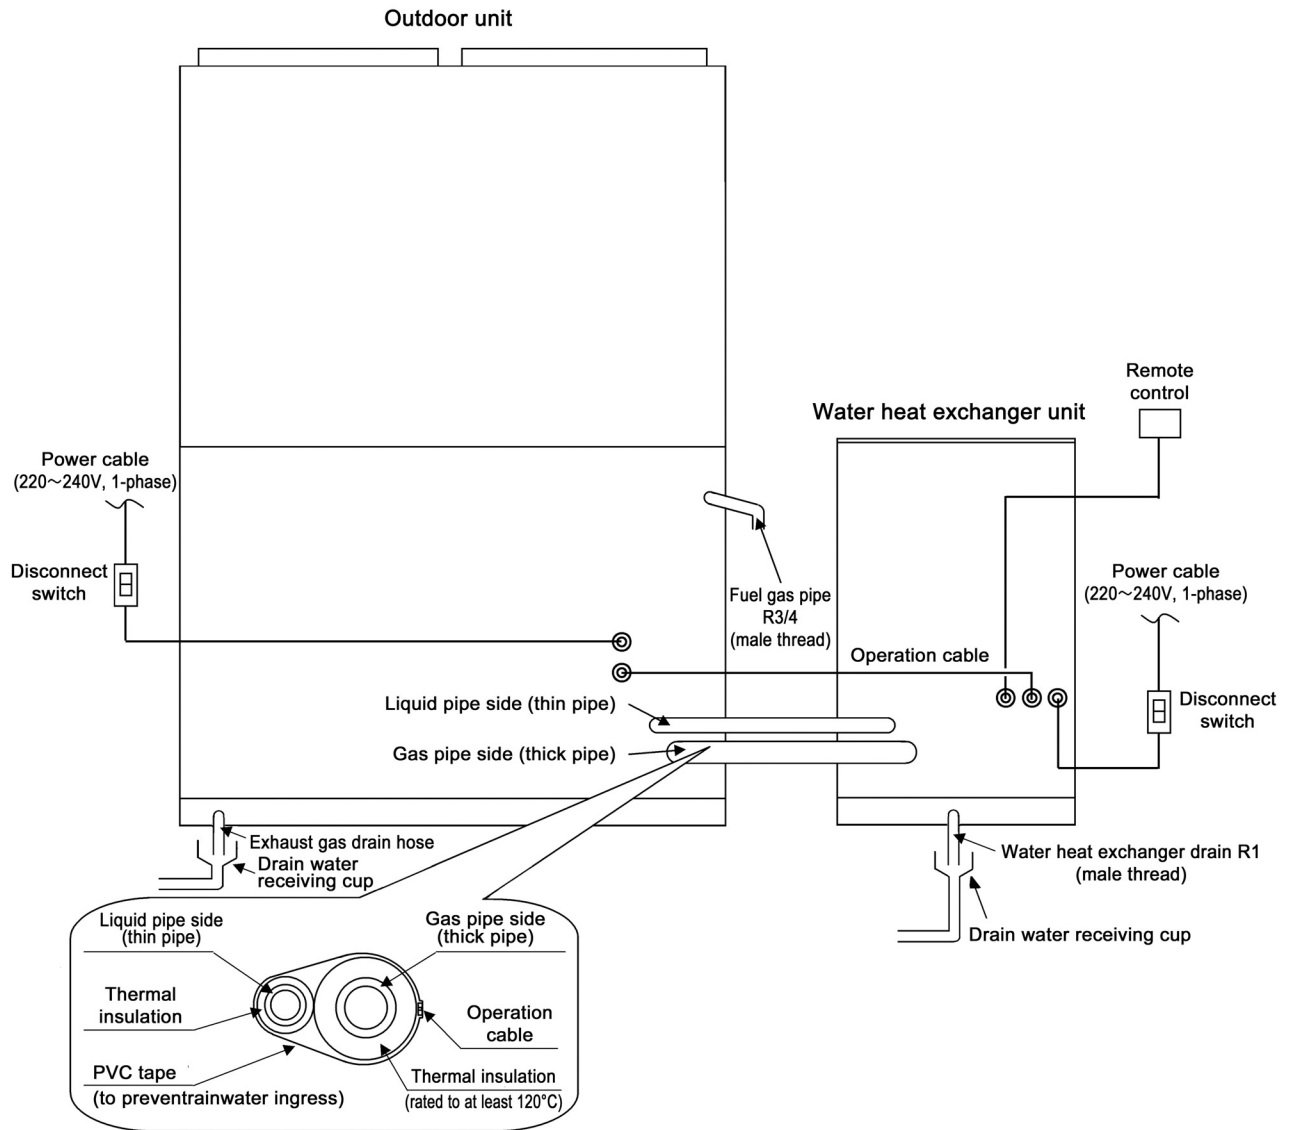

Note: Do not join the exhaust drain pipe and the water heat exchange drain pipe.
Doing so could allow exhaust gas to enter the building and foul the air.

(1) Major system specifications

Water heat exchanger unit		SGP-WE80M1 Cooling capacity 25.0 kW Heating capacity 30.0 kW	SGP-WE170M1 Cooling capacity 50.0 kW Heating capacity 60.0 kW
Function	Maintenance interval	10,000 hours	
	Minimum water capacity	280 liters	500 liters
	Rotating load	Not possible	


Note: M1 type link wiring cannot be mixed with Multi types.

(2) The operating ranges for both cooling and heating are the same as for Multi systems for buildings.

(3) Water heat exchanger temperature range


Cooling temperature range: 5 to 15°C
Heating temperature range: 35 to 55°C

(4) Water heat exchanger unit connection limitations

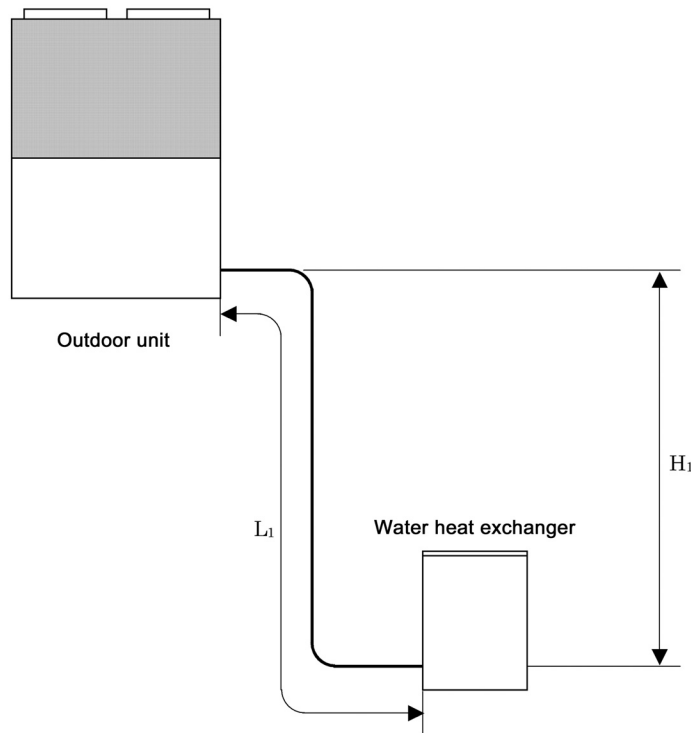


Item	Para-meter	Parameter description	Actual length (m)
Allowable pipe length	L_1	Maximum allowable pipe length	≤ 170 (equivalent length 200)
Allowable difference in height	H_1	If outdoor unit is higher	≤ 50
		If outdoor unit is lower	$\leq 35^*$

* 30m or less when outdoor temperature is below 10°C

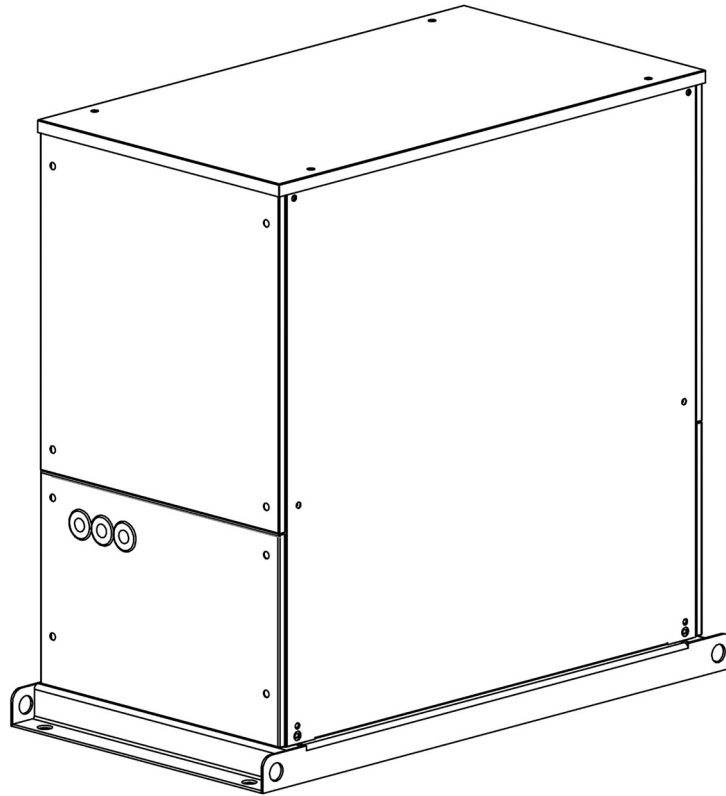

Front View

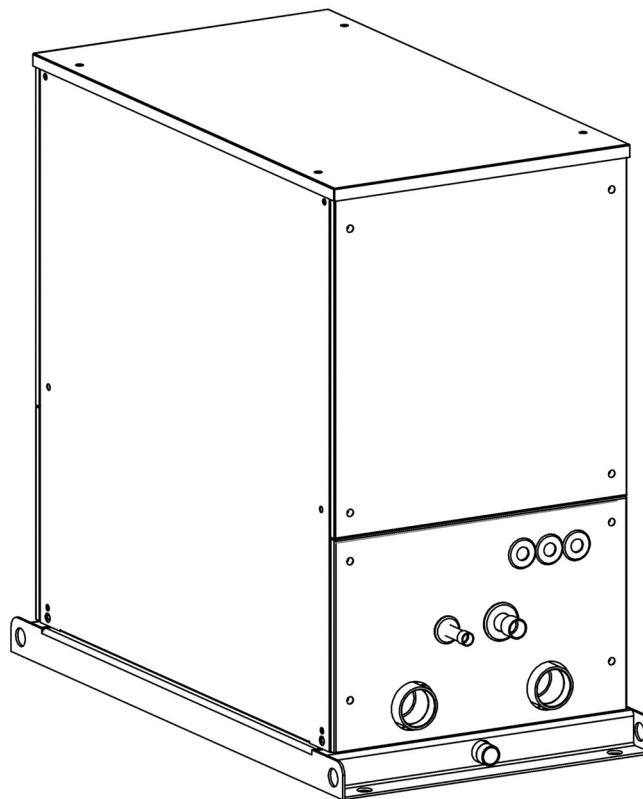

Rear View

(1) Specification tables

1) Water heat exchanger unit

Product Name			Water heat exchanger unit		
Model No.			SGP-WE80M1		
Performance	Cooling capacity	kW	25.0		
	Heating capacity (standard)	kW	30.0		
	Heating capacity (low temperature)	kW	30.0		
	Heating capacity (cold regions)	kW	30.0		
External dimensions	Height	mm	1,000		
	Width	mm	550		
	Depth	mm	965		
Weight		kg	125		
Panel color (Munsell code)			Silky shade (1Y 8.5/0.5)		
Power source			220 to 240 V AC, 50 Hz		
Electrical characteristics	Cooling	Operating current	A	0.07	
		Power consumption	W	10	
	Heating	Operating current	A	0.07	
		Power consumption	W	10	
Standard hot/cold water flow rate		m ³ /h	4.3		
Water pressure loss		kPa	8.5		
Internal water reservoir capacity		m ³	0.01		
Minimum external water capacity		m ³	0.28		
Water circuit limiting pressure		MPa	0.686		
Refrigerant control method			Electronically controlled valve		
Heat exchanger			Hot/cold water heat exchanger		
Freeze prevention device			Protective thermostat		
Piping	Refrigerant	Gas pipe	mm	22.22 dia. (brazed)	
		Liquid pipe	mm	9.52 dia. (brazed)	
	Drain pipe			R1 male thread (25A)	
	Hot/cold water outlet and inlet pipes			Rp2 female thread (50A)	

* The cooling and heating capacities are for operation in accordance with JIS B 8613.

Operating condition	Cooling	Heating (standard)	Heating (low temperature)	Heating (cold regions)
Water temperature of water heat exchanger unit	Outlet 7°C	Outlet 45°C	Outlet 45°C	Outlet 45°C
Outdoor side intake air temperature	35°CDB	7°C DB/6°CWB	2°CDB/ 1°CWB	-10°CDB/ -11°CWB

Note. "Heating (cold regions)" column values apply to operation with outdoor units specified for cold regions.

Product Name			Water heat exchanger unit		
Model No.			SGP-WE170M1		
Performance	Cooling capacity	kW	50.0		
	Heating capacity (standard)	kW	60.0		
	Heating capacity (low temperature)	kW	60.0		
	Heating capacity (cold regions)	kW	60.0		
External dimensions	Height	mm	1,000		
	Width	mm	550		
	Depth	mm	965		
Weight		kg	160		
Panel color (Munsell code)			Silky shade (1Y 8.5/0.5)		
Power source			220 to 240 V AC, 50 Hz		
Electrical characteristics	Cooling	Operating current	A	0.07	
		Power consumption	W	10	
	Heating	Operating current	A	0.07	
		Power consumption	W	10	
Standard hot/cold water flow rate		m ³ /h	8.6		
Water pressure loss		kPa	11.3		
Internal water reservoir capacity		m ³	0.02		
Minimum external water capacity		m ³	0.50		
Water circuit limiting pressure		MPa	0.686		
Refrigerant control method			Electronically controlled valve		
Heat exchanger			Hot/cold water heat exchanger		
Freeze prevention device			Protective thermostat		
Piping	Refrigerant	Gas pipe	mm	28.58 dia. (brazed)	
		Liquid pipe	mm	15.88 dia. (brazed)	
	Drain pipe			R1 male thread (25A)	
	Hot/cold water outlet and inlet pipes			Rp2 female thread (50A)	

* The cooling and heating capacities are for operation in accordance with JIS B 8613.

Operating condition	Cooling	Heating (standard)	Heating (low temperature)	Heating (cold regions)
Water temperature of water heat exchanger unit	Outlet 7°C	Outlet 45°C	Outlet 45°C	Outlet 45°C
Outdoor side intake air temperature	35°CDB	7°CDB, 6°CWB	2°CDB, 1°CWB	-10°CDB, -11°CWB


Note. "Heating (cold regions)" column values apply to operation with outdoor units specified for cold regions.

2) Remote control

■ Specifications


Item	Separately Sold Item (Standard)
(Stop)	RCS-TM80BG
Start/Stop	Push button
Mode select	Push button
Temperature Setting	Push button
FAN speed	Push button
Swing/Air direction	Push button
Timer Setting	Push button
FILTER reset	Push button
Inspection	Push button
(Display)	RCS-TM80BG
Operation	Operation lamp
	Test run Heating preparation Operation preparation Under centralized control Under operation switch control
Operation Mode	AUTO HEAT COOL DRY FAN
Setting Temperature	Numerals
Wind Speed	Wind speed auto Wind speed fast Wind speed strong Wind speed weak
Auto Flap	Mark
Timer	Characters/mark/numerals
Filter	Filter
Ventilation	Ventilation
(Warning)	RCS-TM80BG
Communication/Various Settings	"E01" to "E31"
Unset/Various Settings	"L01" to "L31"
Indoor Blower	"P01"
Ceiling Panel Unconnected	"P09"
Indoor Float Switch	"P10"
Protection Device	"P01" to "P31"
Engine Protection	"A01" to "A31"
Sensor	"F01" to "F31"

(2) External dimension diagram

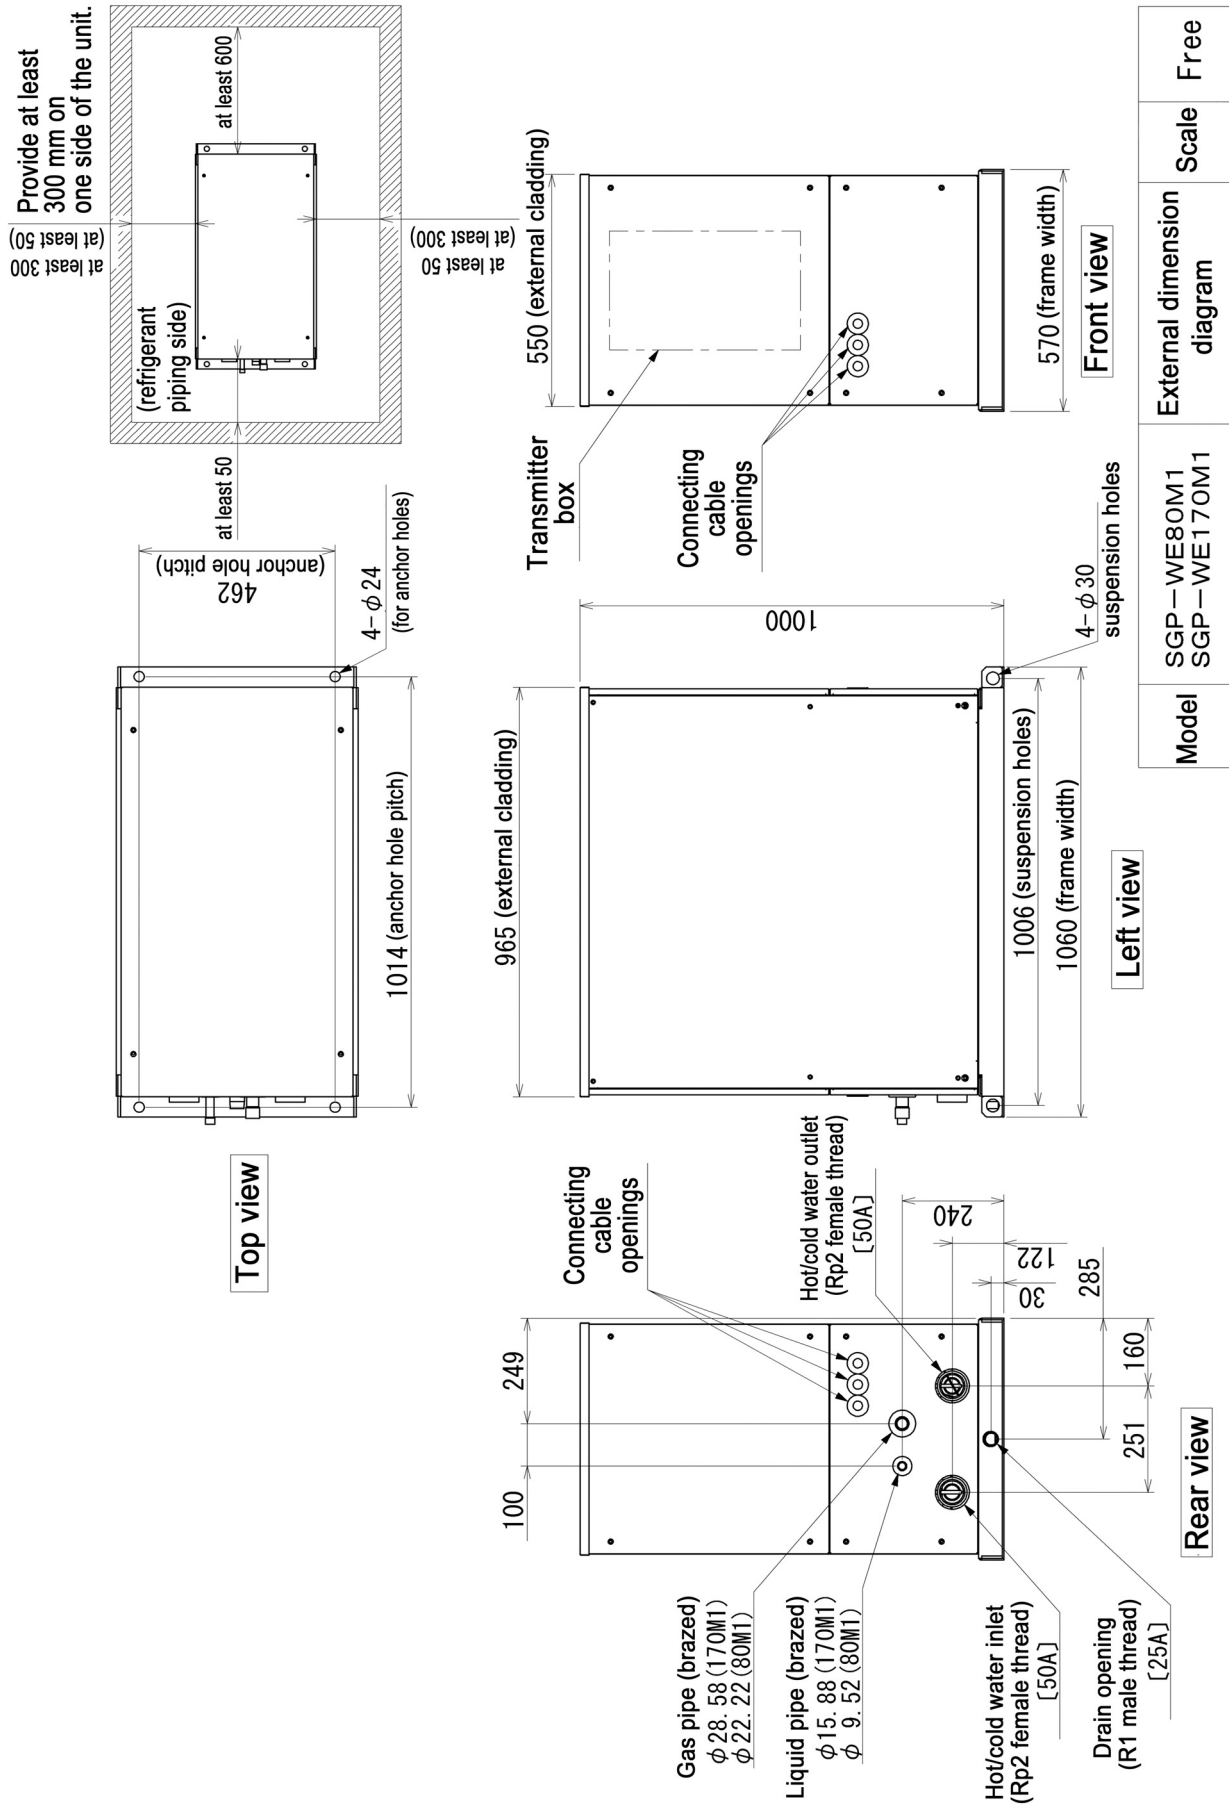


(3) Heating and cooling temperature ranges

Cooling

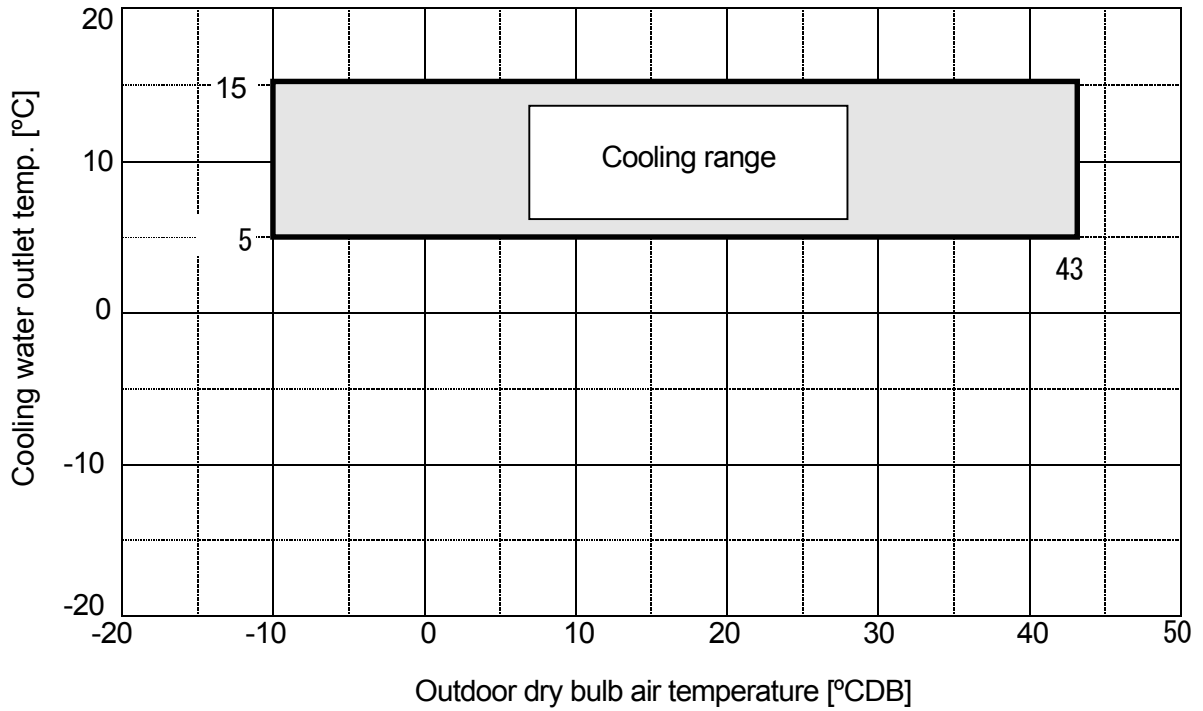

Heating

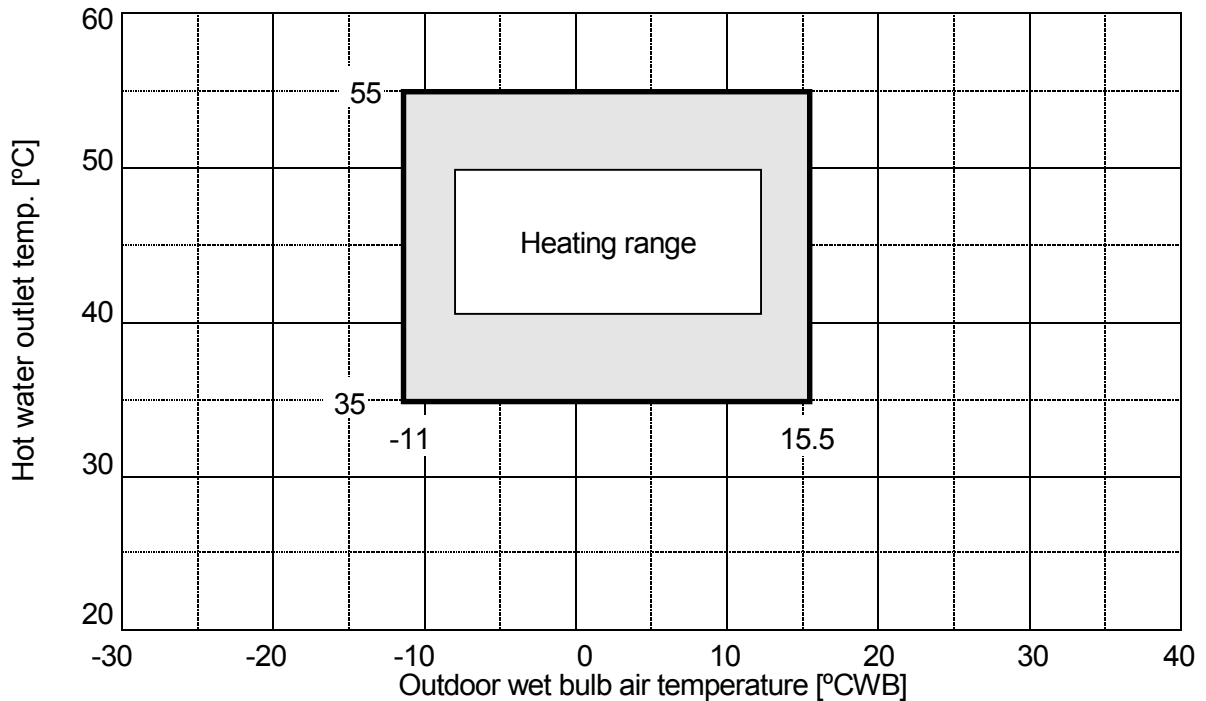




Notes

When starting cooling, the system can operate even if the cold water outlet temperature is somewhat above 15°C.


When starting heating, the system can operate even if the hot water outlet temperature is lower than 35°C.

(1) System block diagram

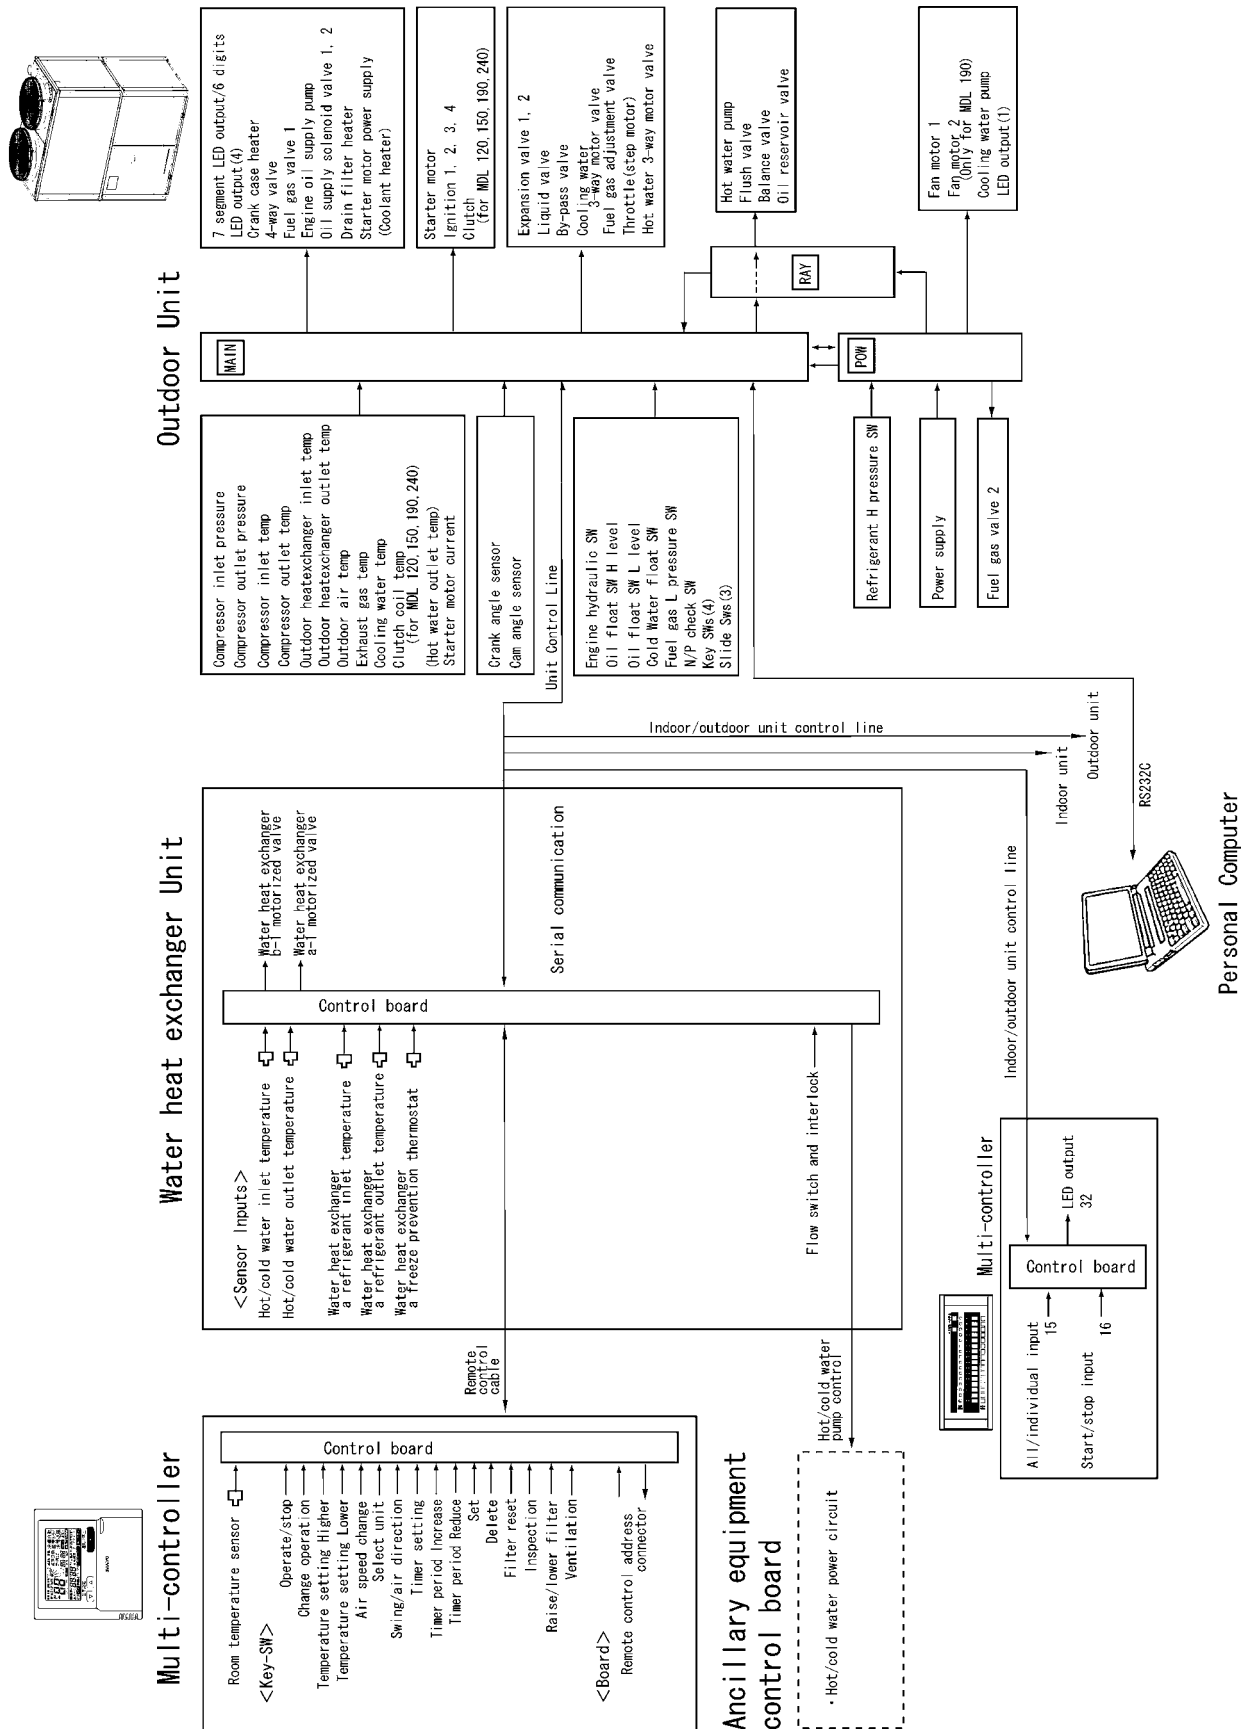


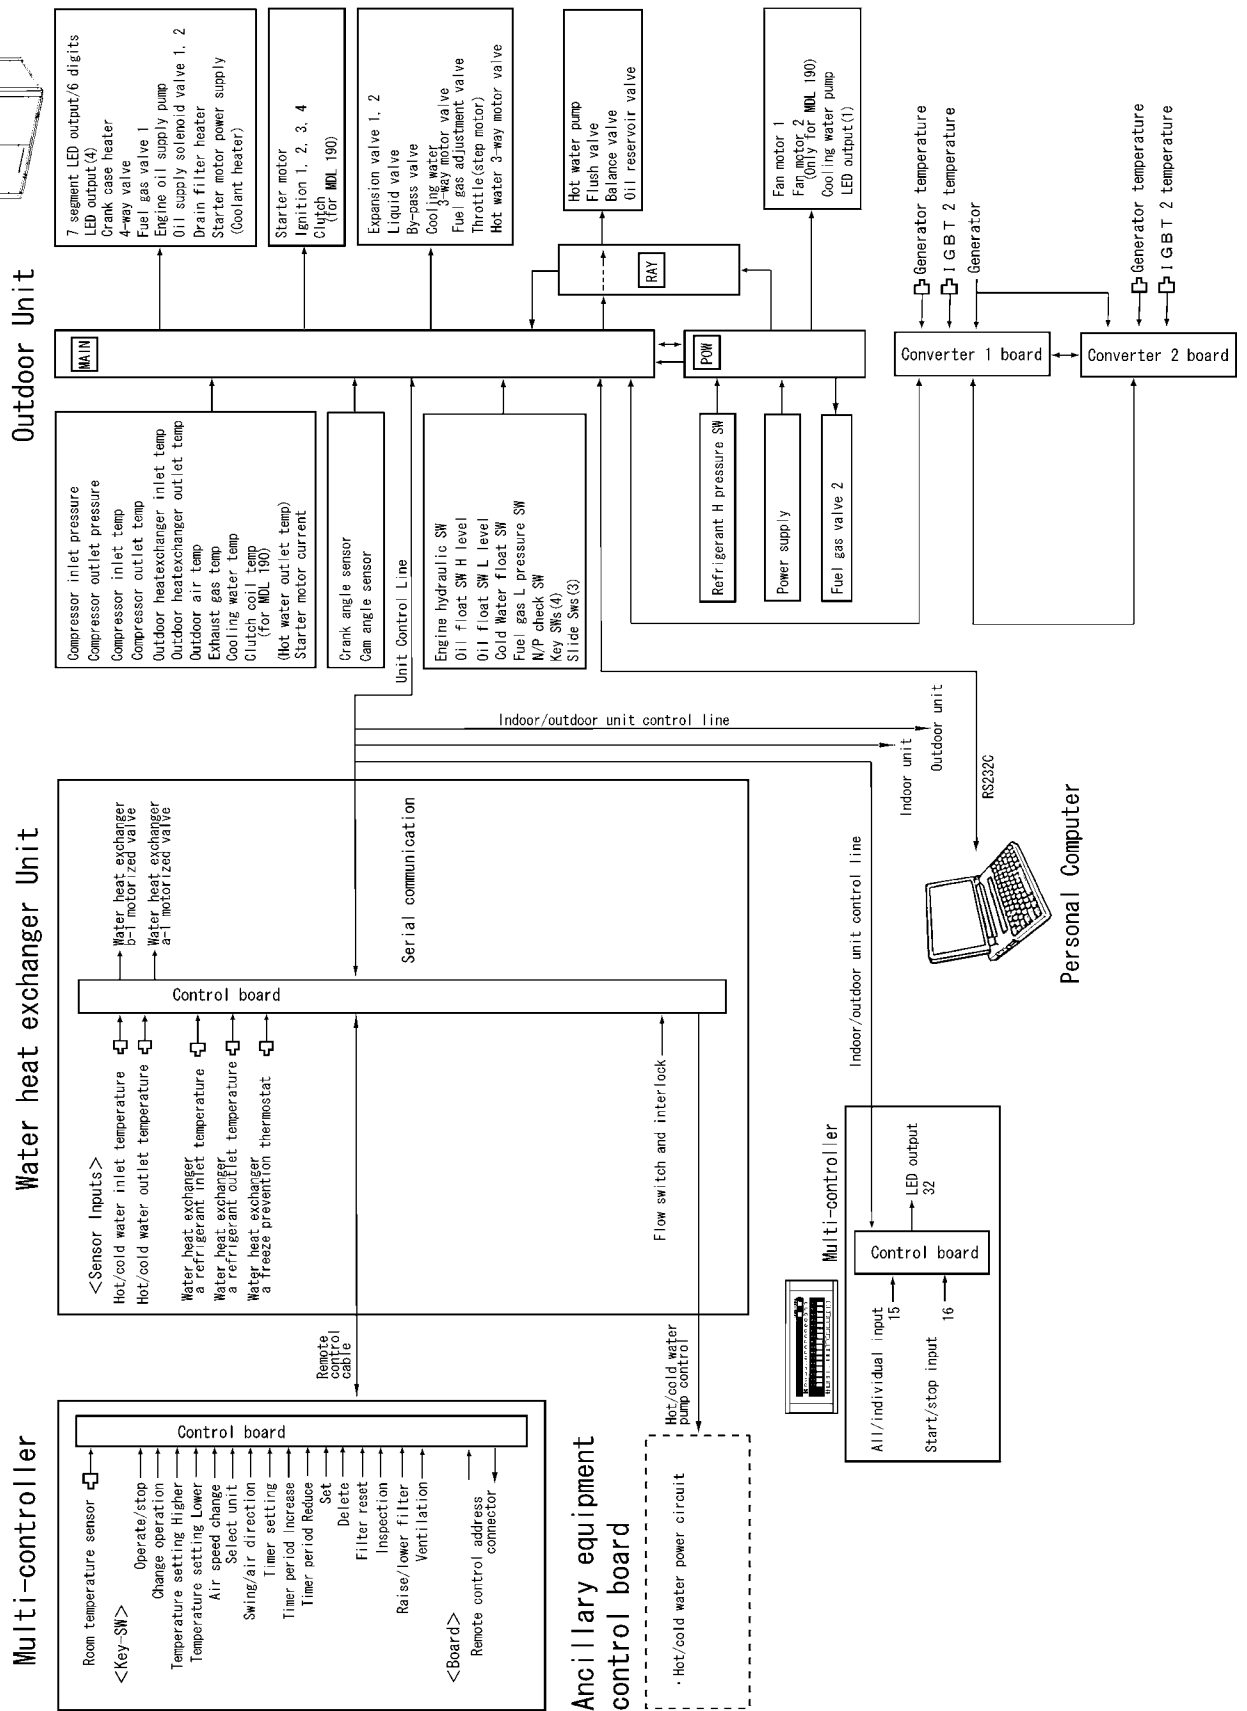

(2) Circuit board controls and connectors

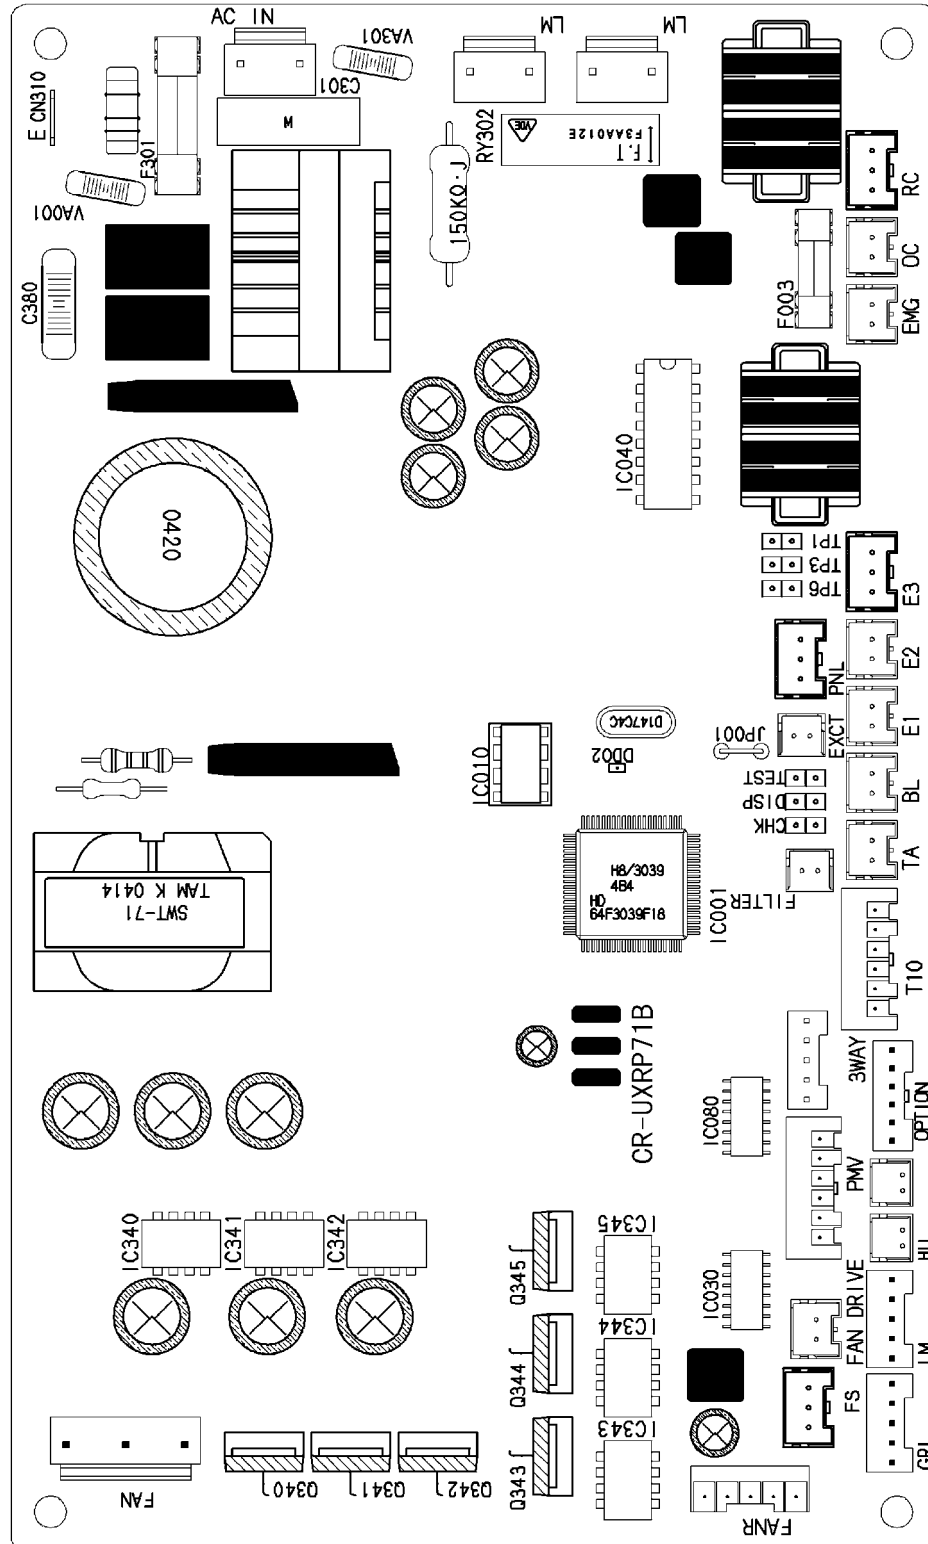

(3) Electrical wiring diagram

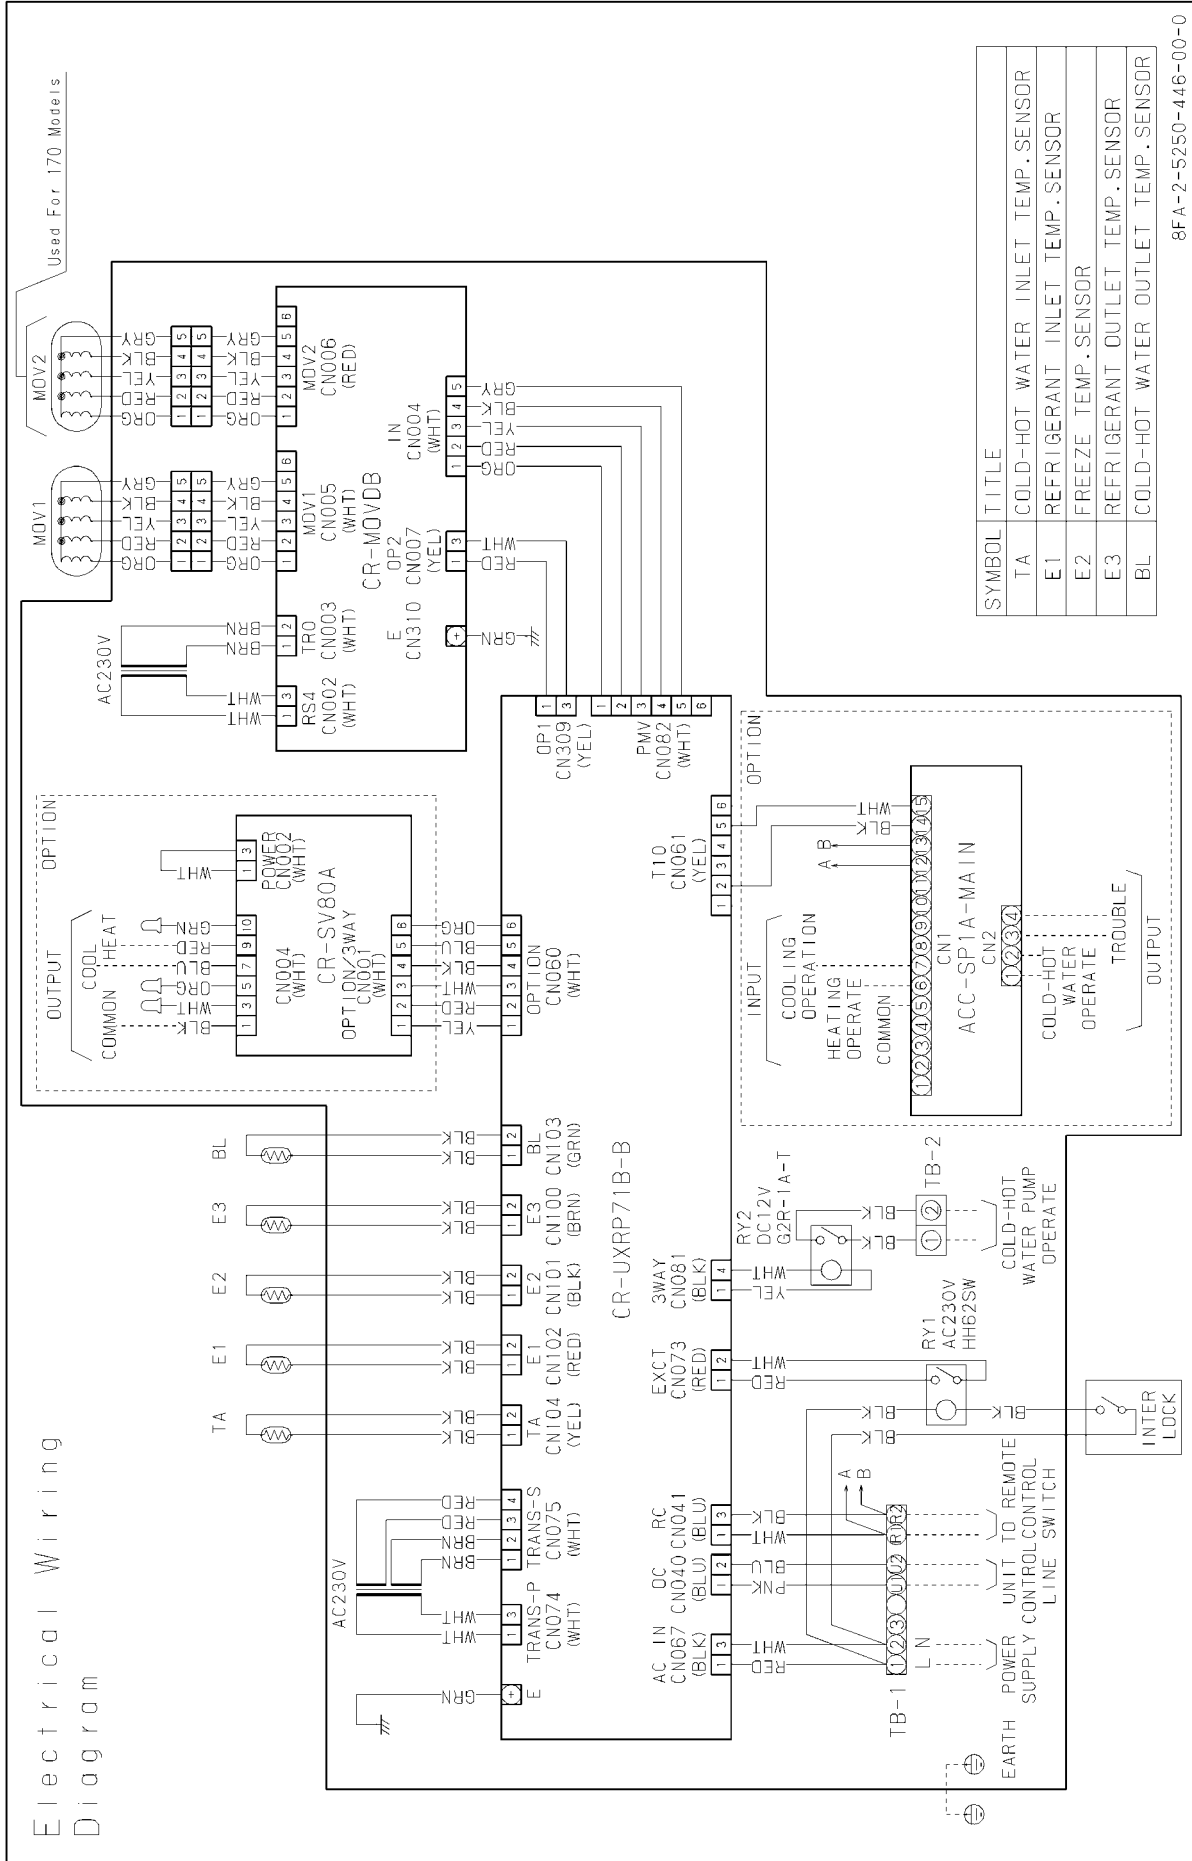

8FA-2-5250-446-00-0



(4) Fault indicators and codes

Reset method [common for 1. to 3.]: After correcting the fault, allow for automatic recovery or press the reset button.



1. Sensor faults (related to the water heat exchanger unit)
 - 1) Faulty water heat exchanger refrigerant inlet temperature sensor (primary or secondary) [F01]
 - Detection method: Open (-20°C) or short circuit ($130^{\circ}\text{C}\leq t$)
 - 2) Faulty water heat exchanger freeze prevention sensor (primary or secondary) [F02]
 - Detection method: Open (-20°C) or short circuit ($130^{\circ}\text{C}\leq t$)
 - 3) Faulty water heat exchanger refrigerant outlet temperature sensor (primary or secondary) [F03]
 - Detection method: Open (-20°C) or short circuit ($130^{\circ}\text{C}\leq t$)
 - 4) Faulty hot/cold water inlet temperature sensor [F10]
 - Detection method: Open (-30°C) or short circuit ($100^{\circ}\text{C}\leq t$)
 - 5) Faulty hot/cold water outlet temperature sensor [F11]
 - Detection method: Open (-30°C) or short circuit ($100^{\circ}\text{C}\leq t$)
2. Serial communication faults or faulty settings (related to remote control of the water heat exchanger unit)
 - 1) Faulty remote control reception [E01]
 - Detection method: There has been no communications addressed to the device for 3 minutes
 - 2) Remote control transmission fault [E02]
 - Detection method: The device cannot read it's own transmissions for 3 minutes
 - 3) Faulty reception from the remote control by the water heat exchanger unit [E03]
 - Detection method: There has been no communications addressed to the device for 3 minutes
 - 4) Faulty reception from the outdoor side by the water heat exchanger unit [E04]
 - Detection method: There has been no communications addressed to the device for 3 minutes
 - 5) Faulty transmission by the water heat exchanger unit to the outdoor unit [E05]
 - Detection method: The device cannot read it's own transmissions for 3 minutes
 - 6) Duplication of indoor unit address [E08]
 - Detection method: Another unit has the same indoor unit address as the device
 - 7) Faulty transmission by the water heat exchanger unit to the remote control [E13]
 - Detection method: The device cannot read it's own transmissions for 3 minutes
3. Other warnings (determined by the water heat exchanger unit)
 - 1) Water heat exchanger unit anti-icing warning [P11]
 - Detection method: While the outdoor unit is operating, freezing temperature is detected by either the anti-icing sensor, the hot/cold water inlet and outlet sensor, or the refrigerant outlet temperature sensor.
 - 2) Interlock warning (ancillary equipment) [P23]
 - Detection method: Within 30 seconds after a hot/cold water pump start command, the interlock does not turn ON, or the interlock turns OFF during a hot/cold water pump start command.
 - 3) Non-volatile memory (EEPROM) fault [F29]
 - Detection method: Inability to write normally

Safety precautions

Safety precautions

Carefully read the following “Safety Precautions” before beginning installation and wiring work. The precautions in this document consist of specific Warnings and Cautions. All concern safety-related issues that require careful attention.

Their meanings are as described below.

-  Warnings: Indicates a potentially hazardous situation in which incorrect handling may result in the death or serious injury of personnel.
-  Cautions: Indicates a potentially hazardous situation in which incorrect handling may result in the injury of personnel or damage to property.

Warning

Equipment installation and electrical work should be entrusted to the dealer where the product is purchased, or to a specialist contractor. Incorrect installation performed with inadequate experience can result in water leakage, electric shock or fire.

Installation and electrical work should be carried out in accordance with the “Procedures and Technical Points for System Installation” and “Procedures and Technical Points for Electrical Wiring Work”.

Defective installation can result in refrigerant or water leakage, electric shock, or fire.

The electrical work should be carried out by a properly qualified electrician in accordance with “Technical Criteria for Electrical Equipment,” “Electrical Wiring Regulations,” “Procedures and Technical Points for System Installation,” “Procedures and Technical Points for Electrical Wiring Work”. Be certain that the power source specifications for gas heat pump air conditioners are satisfied, and to provide a dedicated power circuit.

If the power circuit has insufficient capacity, or if there is a defect in the electrical construction, electric shock or fire could result.

Use a dedicated branch circuit for the electrical cables, and do not share it with other equipment.

Otherwise, secondary damages may occur as a result of breaker tripping.

Cables should be securely connected using the specified cable type and thickness, with strain-relieved terminations that protect them from external force on the cables. Improper or insecure connections may cause overheating and fire.

If the water heat exchanger unit is installed in an equipment room or similar, the system design must ensure that a refrigerant leak would not cause the density limit of 0.3 kg/m^3 to be exceeded, in accordance with the installation criteria for cooling and air conditioning equipment (S0010) published by the High Pressure Gas Safety Institute of Japan.

If this limit is exceeded, either provide an opening to an adjoining room, or provide a ventilation system linked to a gas leak warning device. If the density limit was to be exceeded in the event of a gas leak in a small room, suffocation of inhabitants could result.

Ensure that the installation location is strong enough to support the weight of the water heat exchanger unit (and be certain to secure it with anchor bolts). Inadequate strength of the equipment mounting structure could result in accidents from falling equipment.

Take the appropriate specified measures during installation to protect against strong winds, hurricanes and earthquakes. A defective installation could result in accidents from falling equipment.

If a refrigerant leak should occur during installation operations, ventilate the area.

If refrigerant gas comes in contact with flames from a welding torch, then this could generate poisonous gas.

After installation of the refrigerant piping is complete, conduct a nitrogen leak test to ensure that there are no leaks. If refrigerant gas leaks into a room and comes into contact with fan heaters, stoves, etc., poisonous gas could be generated.

Do not use the same drain pipe for both the water heat exchanger unit and the indoor units. This could cause poisoning due to backflow of exhaust gas to the indoors.

Do not connect the water heat exchanger unit drain pipe to a gutter in which sulfurous or other toxic gases may be generated. The toxic gases could leak indoors and cause poisoning.

Caution

When handling refrigerant gas, do not directly touch the gas. This can cause burns due to freezing.

Do not install the water heat exchanger unit where flammable gas could flow, accumulate or be produced, or where volatile or flammable substances are handled. Fire could occur from ignition of combustible substances or flammable gas.

Connect the drain pipes in accordance with "Procedures and Technical Points for System Installation," and provide sufficient insulation to prevent the formation of condensation. A defect in the piping could cause water leaks into the surrounding property.

Thoroughly insulate refrigerant piping with insulation material in accordance with "Procedures and Technical Points for System Installation." Uninsulated pipes can result in water leaks or burns. (Insulation on the thick pipe must be able to withstand 120°C or greater.)

Provide a proper dedicated earth ground. Do not connect grounding lines to gas or water pipes, lightning rod wires, or telephone grounding lines. Electric shocks may occur if the earth ground is inadequate.

Affix an overload circuit breaker with the correct load capacity to each unit. Installing an incorrect breaker can result in fire due to overheating or short circuits.



(1) Accessories

Accessories

Thermometer

Supplemental documentation

Procedures and Technical Points for System Installation
Procedures and Technical Points for Electrical Wiring Work
Procedures and Technical Points for Test Run
Instruction Manual


Use M10 or larger diameter anchor bolts.

Obtain anchor bolts locally.

(2) Installation location

⚠ Caution

1. Provide the required space for inspection and maintenance (see Figure 2).
Insufficient space at the installation location could result in accidents from falling equipment.
2. If the water heat exchanger unit is installed on a roof or other high location, provide a permanent ladder or hand grips for safe access, and provide railings or hand grips around the water heat exchanger unit to prevent falls.
3. Ensure that the installation location has adequate water drainage.
A defect in the piping could cause water leaks into the surrounding property.
 - Drain pipes that pass indoors should be as short as possible.
 - Drain pipes that pass indoors must be insulated.
 - Make sure that drain water cannot cause trouble for surrounding properties.
4. Use a leveling tool to ensure that the unit is truly horizontal.
Water leaks can result if the unit is not horizontally true.

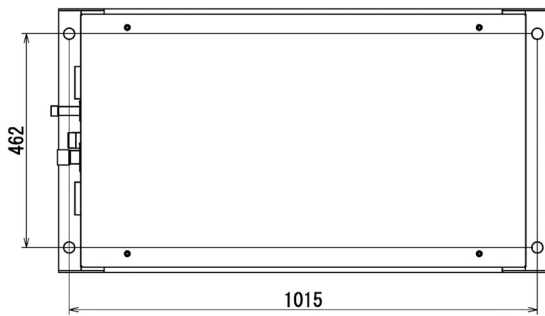

Use M10 or larger diameter anchor bolts.

Figure 1. Anchor Bolt Positioning

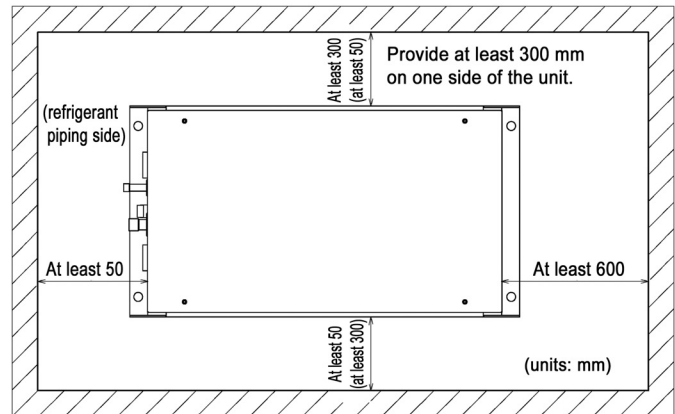


Figure 2

1. Avoid locations near equipment that emits high frequency radiation.
2. When lifting the water heat exchanger unit by suspension:
 - Suspend the unit by attaching ropes to the four suspension rings on the base.
 - When attaching lifting ropes, protect the external finish from scratches by, for example, using timber battens.
 - When lifting by crane, make sure that the crane hook is at least 1 m from the unit.

⚠ Caution

Do not lay the heat exchanger unit on its side during transportation. Internal damage could result in malfunction.

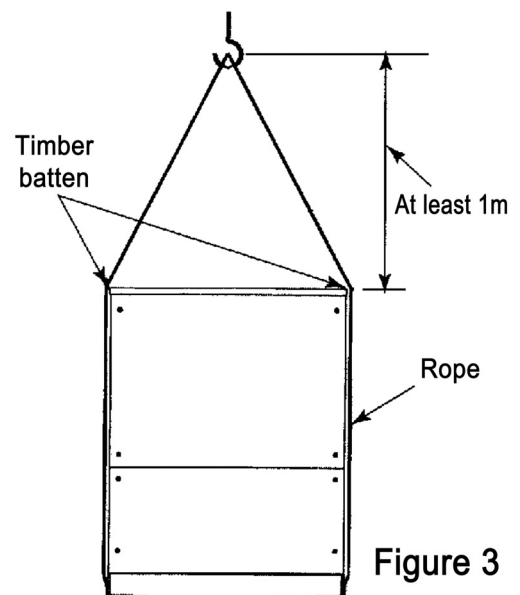


Figure 3

(3) Installing refrigerant piping and charging with refrigerant

⚠ Caution

Always replace the refrigerant with nitrogen before brazing refrigerant piping.
Loose oxide scales can cause motorized valves to seize and clog strainers, which can result in operation failure.

1. Be sure to heed the caution labels on the water heat exchanger unit.
2. Pipe routes should be designed to use the shortest possible length of piping and for the minimum possible difference between high and low points. When bending pipes, be careful to avoid kinking or flattening.
3. Table 1 shows the limitations on refrigerant pipe length between the water heat exchanger unit and the outdoor unit, and on the difference in height between the high and low points. Add 5 kg of refrigerant when a water heat exchanger is installed. Also be sure to provide additional refrigerant charge according to the length of refrigerant piping installed.

Additional refrigerant charge quantity	Allowable pipe length	Allowable difference between high and low points		Refrigerant pipe (C1220T copper pipe, OD × thickness, mm)	
		Outdoor unit is higher	Outdoor unit is lower	Liquid side (1/2H, H material)	Gas side (1/2H, H material)
56g/m(φ9.52) 185g/m(φ15.88)	170 (equivalent length 200 m)	50m	*35m	9.52×1.0 15.88×1.0	22.22×1.0 28.58×1.1

* For cooling operation where the outdoor air temperature is 10°C or less, this value should be 30m.

4. Do not allow dust, dirt, or moisture to become trapped inside the piping.
5. After connecting the piping, perform gas leakage testing by means of an air purge (Figure 4).
Leakage testing may be legally required in accordance with local regulations such as the High Pressure Gas Safety Law (in Japan). After connecting the pipes, perform testing in accordance with the points below (or those for the installation locale), to confirm that there are no leaks from the joints.

Cautions

- 1) Gas pressure in the gas leakage test: F4.15 MPa
- 2) After the gas leakage test, evacuate the system to 667 Pa (-755 mmHg, 5 Torr).
- 3) Do not open outdoor unit valves until the gas leakage and vacuum tests are complete.
- 4) Do not allow the equipment to sit idle for long after completing vacuum testing.

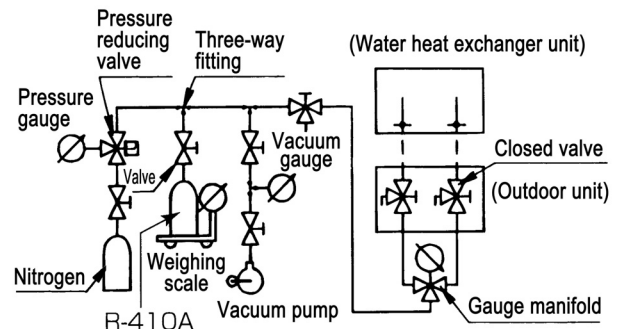


Figure 4

6. Apply thermal insulation to the piping.

Apply the thermal insulation after completing the leak check on the pipe joints.

Apply thermal insulation to both the thick pipes and thin pipes.

7. A gas heat pump air conditioning system must be installed in accordance with the “High pressure gas safety law”, the “Refrigeration safety regulations”, the “Criteria for refrigeration installations” published by the High Pressure Gas Safety Institute of Japan, and all the necessary reporting procedures must be carried out.

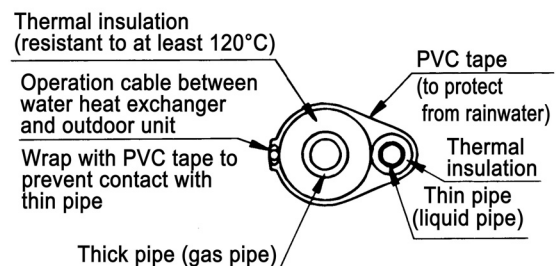


Figure 5

(4) Water piping construction

⚠ Warning

Use only water as the heat-transfer medium for the hot/cold water circuits and the coolant circuits.

Use of other fluids could result in fire or explosion.

⚠ Caution

Use hot/cold water and coolants that complies with refrigeration and air-conditioning equipment water quality guidelines (JRA-GL 02-1994)*.

Poor quality water can cause breakdown or water leaks.

Dispose of brine and cleaning fluid in accordance with applicable local regulations.


Disposing of these items improperly may not only result in legal penalties, but may also degrade the environment and public health.

* Refer to the reference materials for details.


1. Connect the hot/cold water circulation pump to the inlet side of the water heat exchanger.
2. The inside diameter of the water pipe should be larger than that of the connectors (50A), with as few bends as possible in order to minimize flow resistance. Also, install unions or flanges near the unit so that it can be easily removed.
3. Install appropriate valves to enable removal of water and air from the water pipes. Noise, corrosion, and reduced performance are likely to occur if air becomes mixed with the liquid in the pipes.
4. Make sure that the system always contains at least the minimum quantity of water (if necessary, provide a storage tank or similar). Insufficient water in the unit will cause the system to stop frequently or to break down.
5. Provide a flow rate adjustment valve, so that the hot/cold water flow rate can be adjusted while watching the water temperature during testing. Do not touch the adjustment valve after adjusting.
6. Adjust the water pressure so that the pressure in the water heat exchanger does not exceed 0.7 MPa.
7. Include an expansion tank in the water pipe system installation.
8. The hot/cold water flow rate should be within the range shown in Figure 6. Operating outside this range could cause breakdown due to corrosion or freezing of the water heat exchanger unit.

Figure 6. Hydraulic Loss Characteristic

《80》

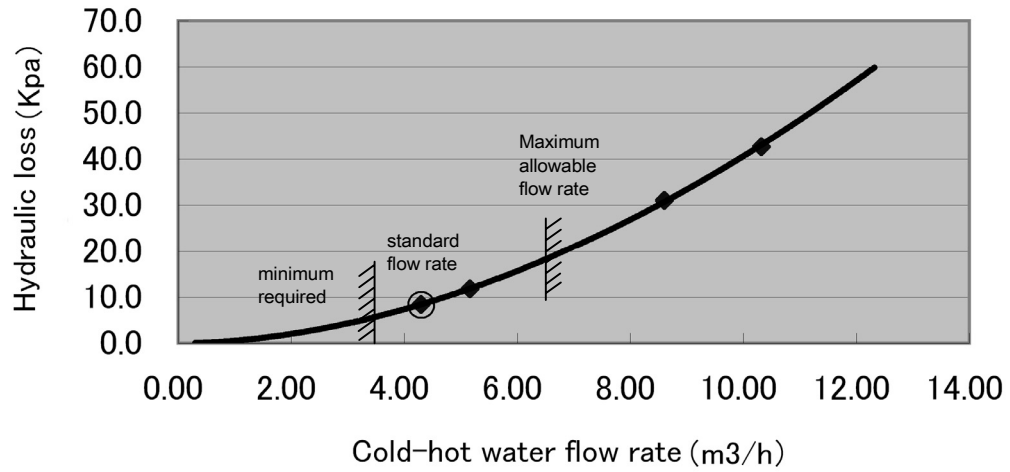

《170》

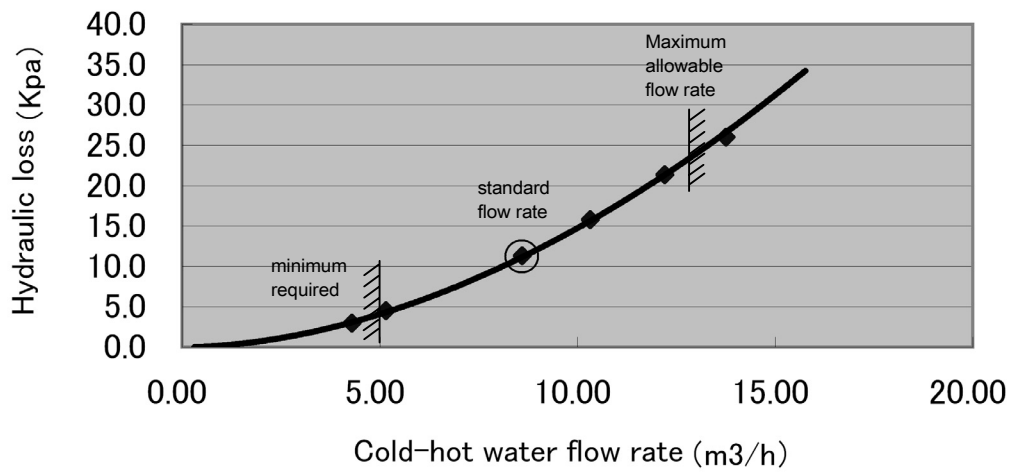


9. Provide sufficient insulation on the water pipes.
Heat loss due to insufficient insulation can result in damage from frozen pipes during severe cold periods.
10. The water heat exchanger unit includes a circuit to automatically start the hot/cold water circulation pump when the external air temperature and the temperature of the water within the unit fall, to prevent freezing within the water heat exchanger unit. However, an improper installation location or insufficient water pipe insulation may result in the water in the pump and hot/cold water pipes freezing before the temperature of the water inside the unit falls sufficiently to start the circulation pump. In this situation, provide a circuit to detect the outdoor air temperature at the location within the overall water circulation system where the water temperature falls fastest, so that the hot/cold water circulation pump starts automatically at the proper time.
11. Provide suitable suspension hardware for the pipes, so that no unreasonable load is applied to the water heat exchanger unit.

(5) Drain piping construction

⚠ Caution

The drain should allow water to run out naturally, so provide a downward slope of at least 1:100. An upward slope could cause leakage from drainage water backflow. When the piping is completed, check the drains to ensure that there are no leaks, and apply insulation to any part of the drain system located indoors to prevent water leaks and condensation. Do not use the same drain pipe for both outdoor and indoor units, as this could cause poisoning due to backflow of exhaust gas to indoors.

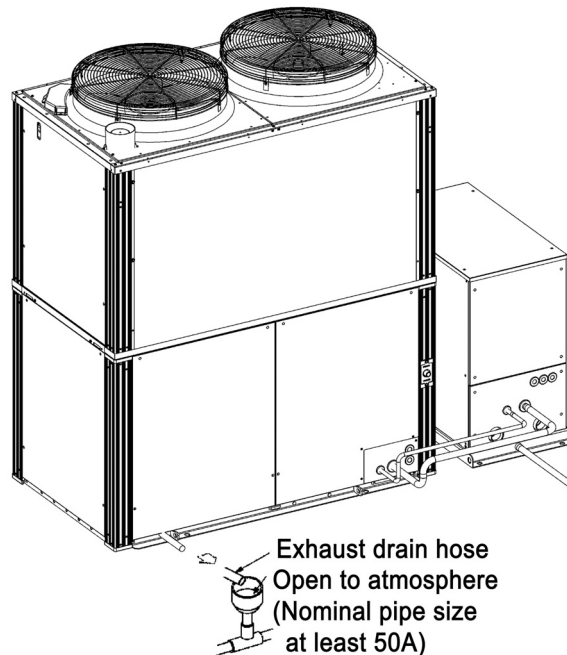

(6) Indoor Installation

⚠ Caution

1. A water heat exchanger unit characteristically exhibits a cold internal temperature, particularly during cooling operation, which can result in condensation on the outside of the unit and elsewhere, leading to dripping that can cause indoor furnishings to become wet. When installing a water heat exchanger unit indoors, always include a drain pan beneath the unit to catch condensation runoff. Also, as necessary, provide thermal insulation for the drain pan.

(7) Using Anti-Vibration Mounts

Rooftop installations should include anti-vibration mounts in cases where noise or vibration may cause problems for residential and meeting rooms beneath. When using anti-vibration mounts, consider installing anti-vibration fittings on the refrigerant and other pipes.

Also consider the following during installation.

- When an outdoor unit and its water heat exchanger unit are installed on the same anti-vibration platform, include flexible couplings in the water piping (Fig. 8-A).
- When only the outdoor unit is installed on anti-vibration mounts, the actual length of refrigerant piping between the outdoor unit and the water heat exchanger should be at least 3m, and include bends in at least two places (Fig. 8-B).

Also, refrigerant piping should be secured with support fixtures at least 1.5m from the indoor unit.

- To install anti-vibration mounts, follow the instructions provided by its manufacturer.

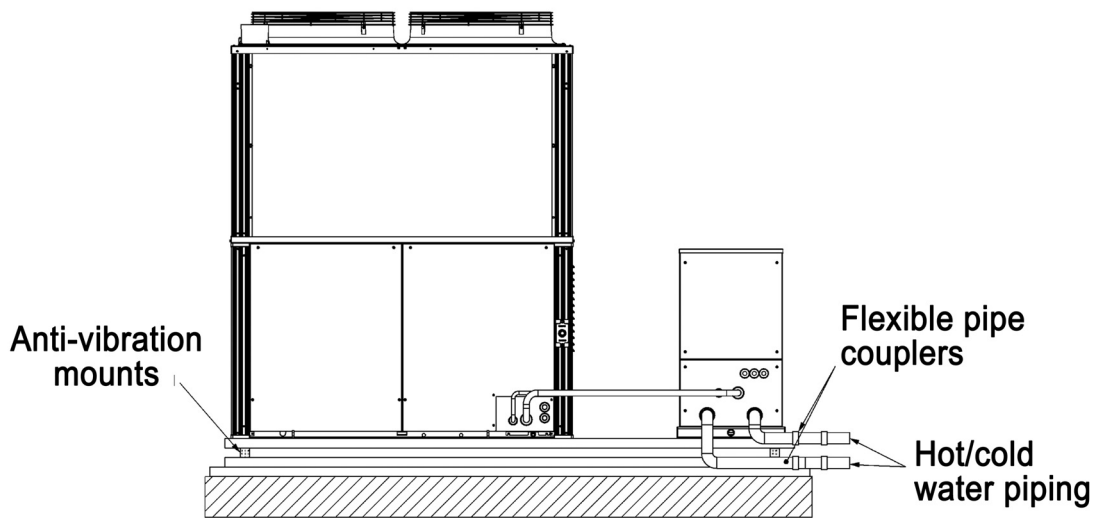


Figure 8-A

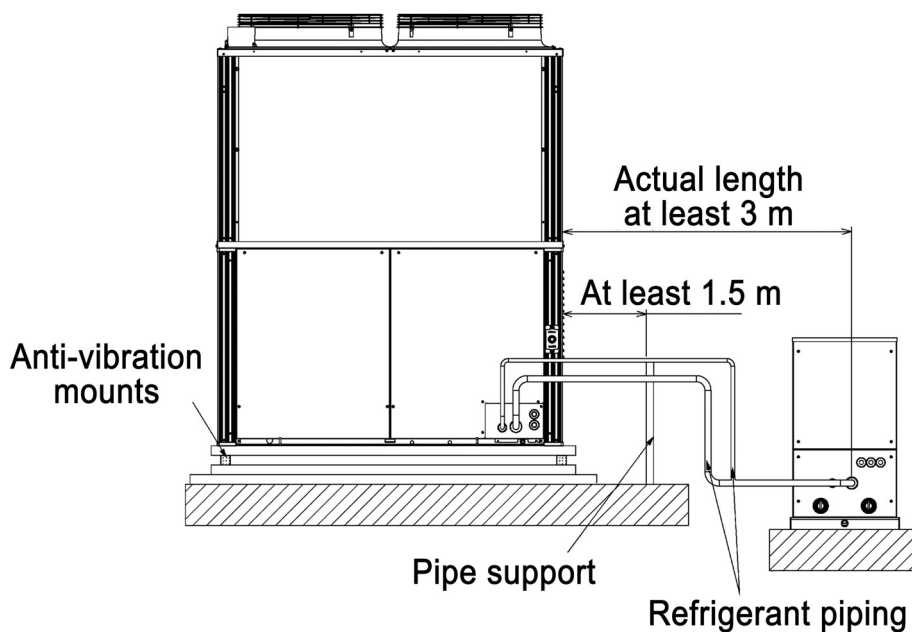


Figure 8-B

Reference: Water quality standard guidelines for A/C and refrigeration equipment (JRA-GL 02-1994)

	Item ⁽¹⁾⁽⁶⁾	Cold water systems		Hot water systems ⁽³⁾				Tendency ⁽²⁾	
				Lower temp. hot water systems		High temp. hot water systems			
		Circulating 20°C or less	Supply	Circulating 20 to 60°C	Supply	Circulating 60 to 90°C	Supply	Corrosion	Scaling buildup
Standard Items	pH (@25°C)	6.8 – 8.0	6.8 – 8.0	7.0 – 8.0	7.0 – 8.0	7.0 – 8.0	7.0 – 8.0		
	Elect. conductivity (mS/m) (@25°C) { S/cm } (@25°C) ⁽¹⁾	40 or less {400 or less}	30 or less {300 or less}	30 or less {300 or less}	30 or less {300 or less}	30 or less {300 or less}	30 or less {300 or less}		
	Chloride ions (mg/l Cl ⁻)	50 or less	50 or less	50 or less	50 or less	30 or less	30 or less		
	Sulphate ions (mg/l SO ₄ ²⁻)	50 or less	50 or less	50 or less	50 or less	30 or less	30 or less		
	Acid consumption (pH 4.8, mg/l CaCO ₃)	50 or less	50 or less	50 or less	50 or less	50 or less	50 or less		
	Total hardness (mg/l CaCO ₃)	70 or less	70 or less	70 or less	70 or less	70 or less	70 or less		
	Calcium hardness (mg/l CaCO ₃)	50 or less	50 or less	50 or less	50 or less	50 or less	50 or less		
	Silica ions (mg/l SiO ₂)	30 or less	30 or less	30 or less	30 or less	30 or less	30 or less		
Reference	Iron (mg/l Fe)	1.0 or less	0.3 or less	1.0 or less	0.3 or less	1.0 or less	0.3 or less		
	Copper (mg/l Cu)	1.0 or less	0.1 or less	1.0 or less	0.1 or less	1.0 or less	0.1 or less		
	Sulfide ions (mg/l S ²⁻)	Undetectable	Undetectable	Undetectable	Undetectable	Undetectable	Undetectable		
	Ammonium ions (mg/l NH ₄ ⁺)	1.0 or less	0.1 or less	0.3 or less	0.1 or less	0.1 or less	0.1 or less		
	Residual chloride (mg/l Cl)	0.3 or less	0.3 or less	0.25 or less	0.3 or less	0.1 or less	0.3 or less		
	Free carbonate (mg/l CO ₂)	4.0 or less	4.0 or less	0.4 or less	4.0 or less	0.4 or less	4.0 or less		
	Ryznar stability index	–	–	–	–	–	–		

	Item ⁽¹⁾⁽⁶⁾	Coolant systems ⁽⁴⁾			Tendency ⁽²⁾	
		Circulating systems		Flow-thru systems		
		Circulating	Supply	Flow-thru water	Corrosion	Scaling buildup
Standard Items	pH (@25°C)	6.5 – 8.2	6.0 – 8.0	6.8 – 8.0		
	Elect. conductivity (mS/m) (@25°C) { S/cm } (@25°C) ⁽¹⁾	80 or less {800 or less}	30 or less {300 or less}	40 or less {400 or less}		
	Chloride ions (Cl ⁻ mg/l)	200 or less	50 or less	50 or less		
	Sulphate ions (mg/l SO ₄ ²⁻)	200 or less	50 or less	50 or less		
	Acid consumption (pH 4.8, mg/l CaCO ₃)	100 or less	50 or less	50 or less		
	Total hardness (mg/l CaCO ₃)	200 or less	70 or less	70 or less		
	Calcium hardness (mg/l CaCO ₃)	150 or less	50 or less	50 or less		
	Silica ions (mg/l SiO ₂)	50 or less	30 or less	30 or less		
Reference	Iron (mg/l Fe)	1.0 or less	0.3 or less	1.0 or less		
	Copper (mg/l Cu)	0.3 or less	0.1 or less	1.0 or less		
	Sulfide ions (mg/l S ²⁻)	Undetectable	Undetectable	Undetectable		
	Ammonium ions (mg/l NH ₄ ⁺)	1.0 or less	0.1 or less	1.0 or less		
	Residual chloride (mg/l Cl)	0.3 or less	0.3 or less	0.3 or less		
	Free carbonate (mg/l CO ₂)	4.0 or less	4.0 or less	4.0 or less		
	Ryznar stability index	6.0 – 7.0	–	–		

Notes

- (1) Item names, term definitions and units are based on the JIS K 0101 standard. However, units and values in brackets { } are common units included for reference.
- (2) The ' ' symbol indicates whether an item primarily affects corrosion or scale buildup.
- (3) Higher temperatures (40°C+) accelerate corrosion, so that uncoated ferrous materials must be protected by countermeasures such as an anti-corroding agent or anti-oxidizing treatment.
- (4) In coolant systems with a closed-loop cooling tower, circulating water and its replenishment supply, and evaporator water and its replenishment supply, depend on their respective water quality standards.
- (5) The source of water and replenishment supply may be tap water, industrial water, artesian water and pure water. Recycled waste water and softening-processed water are excepted.
- (6) The fifteen items in the above tables are typical factors affecting corrosion and scaling buildup.

(1) Cable capacity


Cable capacity (Use 600 V, CAT IV vinyl-insulated power cable, obtained locally)

Applicable Unit		Water Heat Exchanger Model
Model type		SGP-WE80M1
Switch capacity (A)		30
Fuse capacity (A)		15
Power cable (metal or PVC pipe) with 2% voltage drop standard	Minimum cable size	2 mm ²
	Up to 25 m	2 mm ²
	Up to 50 m	2 mm ²
	Up to 75 m	2 mm ²
	Up to 100 m	2 mm ²
Grounding cable size		2 mm ²
Inter-unit operation cable size		0.5 mm ² to 2 mm ² (Up to 1000 m total)
Remote control cable size		0.5 mm ² to 1.25 mm ² (Up to 300 m total)
Hot/cold water pump cable size		0.5 mm ² to 2 mm ² (Up to 300 m total)

Applicable Unit		Water Heat Exchanger Model
Model type		SGP-WE170M1
Switch capacity (A)		30
Fuse capacity (A)		15
Power cable (metal or PVC pipe) with 2% voltage drop standard	Minimum cable size	2 mm ²
	Up to 25 m	2 mm ²
	Up to 50 m	2 mm ²
	Up to 75 m	2 mm ²
	Up to 100 m	2 mm ²
Grounding cable size		2 mm ²
Inter-unit operation cable size		0.5 mm ² to 2 mm ² (Up to 1000 m total)
Remote control cable size		0.5 mm ² to 1.25 mm ² (Up to 300 m total)
Hot/cold water pump cable size		0.5 mm ² to 2 mm ² (Up to 300 m total)

Values within parentheses () are the maximum length in meters for the minimum cable size.

(2) Electrical connection diagram

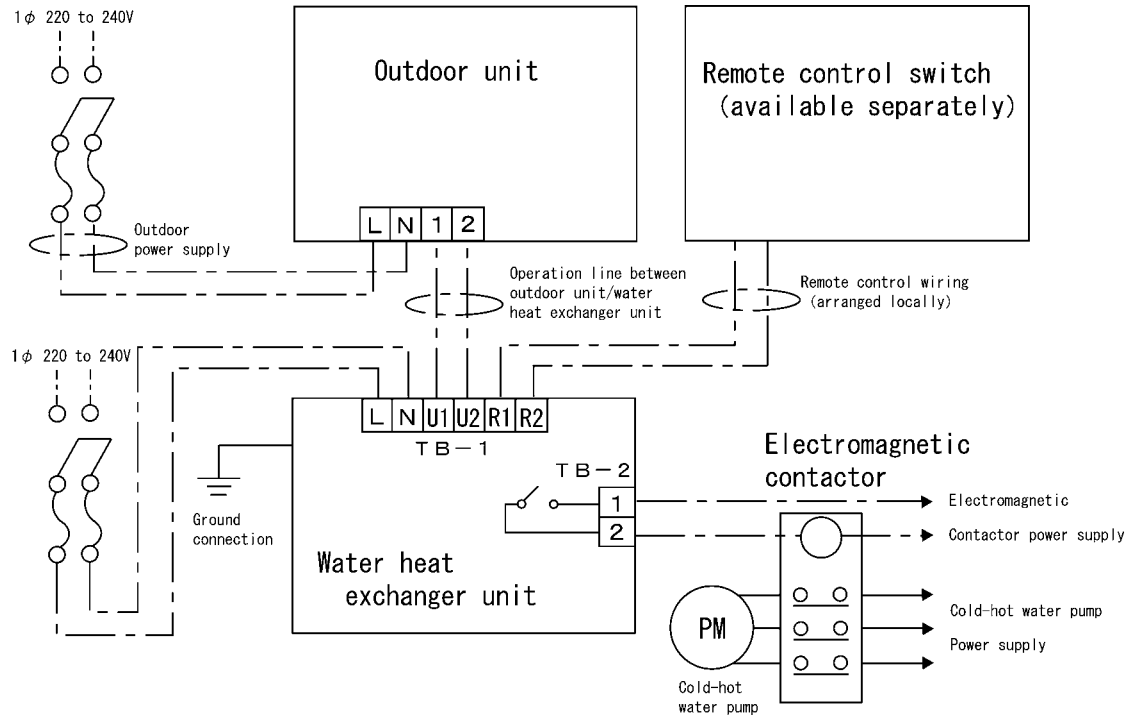

About hot/cold water pump output and the interlock

Hot/cold water output force

Terminals 1 and 2 of connector TB3 on the water heat exchanger unit terminal board are outputs.

Output format: Non-voltage contacts (closed = pump on, open = pump off)
 Maximum contact point rating: 200 V AC, 0.8 A ($\cos\theta = 0.7$)

Hot/cold water pump interlock input

Terminals 1 and 2 of connector TB4 on the water heat exchanger unit terminal board are inputs.

Input format: Non-voltage contacts (closed = pump on, open = pump off)
 Current rating is 30 mA at 12 V DC



Caution.

Always connect the flow switch in parallel with the pump operating signal to protect against freezing.


Flow switch rating: Contacts should be closed when the flow rate is 4 m³/h or more.


(3) Precautions regarding electrical work

Read these important precautions regarding safety carefully, and be sure to observe them.

The precautions shown here are classified into “ Warning” and “ Caution.” However, they are all important items regarding safety, and must be observed.

The following shows the symbols used and their meanings.

Warning:  Indicates a potentially hazardous situation in which incorrect handling may result in the death or serious injury of personnel.

Caution:  Indicates a potentially hazardous situation in which incorrect handling may result in the injury of personnel or damage to property.

(1) Safety precautions

Warning

Electrical work should be entrusted to the dealer where this product was purchased, or a professional contractor. Problems due to incorrectly carrying out the work yourself may result in leaking refrigerant, electric shock, fire, etc.

The electrical work should be carried out by a properly qualified electrician in accordance with “Technical Criteria for Electrical Equipment,” “Electrical Wiring Regulations (chiller),” and “Procedures and Technical Points for Electrical Wiring Work.” Incorrect wiring work may result in an electric shock or fire.

(2) Electrical wiring work precautions

Warning

Use a dedicated branch circuit for the electrical cables, and do not share it with other equipment. Otherwise, secondary damage may occur as a result of the circuit breaker tripping.

When carrying out wiring work, use the designated cables (type and thickness) and connect them securely. Fix the cables properly in place to ensure that external force from the cables does not transmit to the connection terminals. Not connecting the cables securely or not fixing them in place properly may result in the generation of heat, fire, etc.

Caution

Attach an overcurrent circuit breaker of the set capacity to each unit. Installing an inappropriate overcurrent circuit breaker may result in a fire due to heat generation, short circuit, etc.

Attach an earth leakage breaker of the set capacity to each unit. Not installing an earth leakage breaker (earth leakage breaker rating of 30 mA within 0.1 sec) may result in an electric shock or fire.

For the ground connection, install a D type connection in accordance with the Technical Criteria for Electrical Equipment (formerly type 3 ground connection).

Do not connect the ground cable to a gas pipe, water pipe, lightning conductor, or telephone ground cable. Inadequate grounding may result in an electric shock.

An inverter is used in the unit, so use an earth leakage breaker that is compliant with the inverter.

Use the clammer for cables in the outdoor unit to fix the power supply cable and the operation cable for the outdoor and water heat exchanger units to ensure they do not come into contact with parts such as the following.

Refrigerant pipe, thin pipe for pressure outlet, or any other part of the refrigerant circuit


Sharp edges of attachments and other objects

For the operation cables (remote control cable, operation cable for the indoor, outdoor and water heat exchanger units), use signal cables that are easy to differentiate from the power supply cable (AC200-240V). Also, do not run the power cable with the operation cables.

Keep the power supply cable and operation cables of the unit 3 m or more away from the chiller, antenna cable, operation cable, power supply cable, and other parts of equipment such as a TV, radio, stereo, interphone, personal computer, word processor, and telephone. Noise from such equipment may have adverse effects.

(1) Installation and center of gravity

1) Position of center of gravity

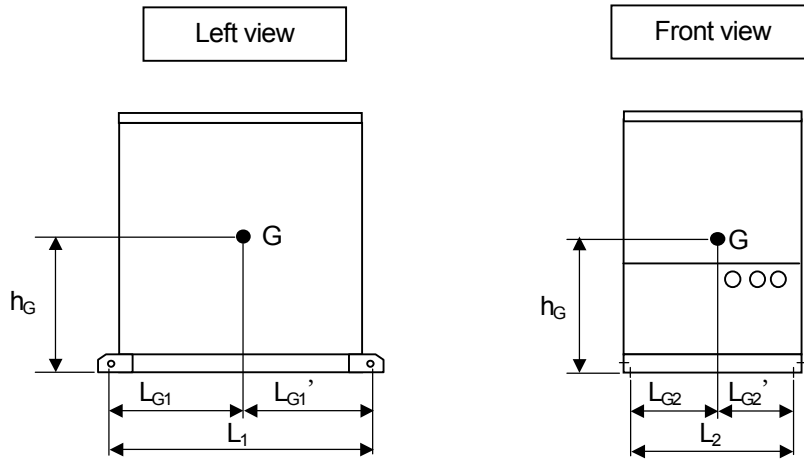

Outdoor unit type	Position of mounting points		Position of center of gravity				Product weight (kg)	
	L_1	L_2	L_{G1}	L_{G1}'	L_{G2}	L_{G2}'		h_G
WE80	1014	462	470	544	206	256	497	125
WE170	1014	462	515	499	239	223	536	160

* For earthquake-resistant design, use the smallest value of L_{G1} , L_{G1}' , L_{G2} , or L_{G2}' .

(4) Example anchor bolt calculation

Example of evaluation using calculations

(1) Anchor bolt conditions

- 1) Total no. of bolts (N) $N = 4$ current models have four bolts
- 2) Bolt diameter (D) $D = 12$ mm for M12 bolts
- 3) Bolt cross-sectional area (A) $A = \pi D^2 / 4 = 113$ mm²
- 4) Bolts on one side (end-on direction, n_1) $n_1 = 2$ current models have two bolts
 (broadside direction, n_2) $n_2 = 2$ current models have two bolts

- 5) The installation method is for "embedded J or JA type bolts," on a 15-cm-thick slab
 Anchor bolt allowable short-term tensile load (T_a) $T_a = 11,760$ N
 (The installation method may also be selected after completing calculations.)

(2) Calculation

- 1) Design horizontal seismic magnitude (K_H) $K_H = 1.0$ Installation location: K_H roof : 1.0
 ground : 0.4

- 2) Operating load (W)
 (= operating mass \times 9.8) $W = 1,568$ N

- 3) Horizontal earthquake force (F_H) $F_H = K_H \cdot W = 1,568$ N

- 4) Height of center-of-gravity (h_G) $h_G = 536$ mm

- 5) Vertical earthquake force (F_V) $F_V = F_H / 2 = 784$ N

- 6) Distance from center-of-gravity to bolt
 End-on direction (L_{G1}) $L_{G1} = 499$ mm

- Broadside direction (L_{G2}) $L_{G2} = 223$ mm

- 7) Bolt span
 End-on direction (L_1) $L_1 = 1,014$ mm

- Broadside direction (L_2) $L_2 = 462$ mm

8) Actual strength of anchor bolts

Short-term allowable tensile stress (f_t) $f_t = \boxed{176}$ N/mm² for SS400, $f_t = 176$

Short-term allowable shear stress (f_s) $f_s = \boxed{99}$ N/mm² for SS400, $f_s = 132 \times 0.75$

9) Pull-out load on one bolt

End-on direction (R_{b1}) $R_{b1} = \frac{F_H \cdot h_G - (W - F_V) L_{G1}}{L_1 \cdot n_1} = \boxed{222}$ N

Broadside direction (R_{b2}) $R_{b2} = \frac{F_H \cdot h_G - (W - F_V) L_{G2}}{L_2 \cdot n_2} = \boxed{720}$ N

10) Anchor bolt shear stress ()

$$\tau = \frac{F_H}{N \cdot A} = \boxed{3.5} \text{ N/mm}^2$$

11) Mounting bolt tensile stress

End-on direction (δ_1)

$$\delta_1 = \frac{R_{b1}}{A} = \boxed{2.0} \text{ N/mm}^2$$

Broadside direction (δ_2)

$$\delta_2 = \frac{R_{b2}}{A} = \boxed{6.4} \text{ N/mm}^2$$

12) Allowable tensile stress on a bolt subject to both tensile and shear stresses (f_{ts})

$$f_{ts} = 1.4 \cdot f_t - 1.6 \tau = \boxed{240.9} \text{ N/mm}^2$$

(3) Judgment

1) Tensile load

End-on direction, if $R_{b1} < T_a$

$$\boxed{\text{OK}} \quad R_{b1} = \boxed{222} < T_a = \boxed{11,760}$$

Broadside direction, if $R_{b2} < T_a$

$$\boxed{\text{OK}} \quad R_{b2} = \boxed{720} < T_a = \boxed{11,760}$$

2) Shear stress

if $\tau < f_s$,

$$\boxed{\text{OK}} \quad \tau = \boxed{3.5} < f_s = \boxed{99}$$

3) Tensile stress

End-on direction: if $\delta_1 < f_t$

$$\boxed{\text{OK}} \quad \delta_1 = \boxed{2.0} < f_t = \boxed{176.0}$$

$$\delta_1 < f_{ts} \quad \boxed{\text{OK}} \quad \delta_1 = \boxed{2.0} < f_{ts} = \boxed{240.9}$$

Broadside direction: if $\delta_2 < f_t$

$$\boxed{\text{OK}} \quad \delta_2 = \boxed{6.4} < f_t = \boxed{176.0}$$

$$\delta_2 < f_{ts} \quad \boxed{\text{OK}} \quad \delta_2 = \boxed{6.4} < f_{ts} = \boxed{240.9}$$