

For Indoor Unit

SANYO INSTALLATION INSTRUCTIONS

– Inverter Split System Air Conditioner – COOL/DRY/HEAT Model

This air conditioner uses the new refrigerant R410A.

Contents

Page

IMPORTANT!

Please Read Before Starting 2

1. GENERAL 3

- 1-1. Tools Required for Installation (not supplied)
- 1-2. Accessories Supplied with Unit
- 1-3. Optional Copper Tubing Kit
- 1-4. Type of Copper Tube and Insulation Material
- 1-5. Additional Materials Required for Installation

2. INSTALLATION SITE SELECTION 4

- 2-1. Indoor Unit
- 2-2. Embedding the Tubing and Wiring

3. HOW TO INSTALL THE INDOOR UNIT 6

- 3-1. Remove the Rear Panel from the Unit
- 3-2. Make a Hole
- 3-3. Install the Rear Panel on the Wall
- 3-4. Removing and Installing the Grille
- 3-5. Shape the Indoor Side Tubing
- 3-6. Wiring Instructions
- 3-7. Wiring Instructions for Inter-unit Connections
- 3-8. Mounting
- 3-9. Drain Hose

4. MULTIPLE SWITCH ON THE REMOTE CONTROL UNIT INDOOR UNIT TYPES (SAP-KRV184EH, KRV244EH) (SAP-KRV186EH, KRV246EH) (SAP-KRV96EHDS) 19

5. HOW TO TEST RUN THE AIR CONDITIONER ... 20

6. REMOTE CONTROL UNIT INSTALLATION POSITION 22

- 6-1. Mounting on a Wall

7. ADDRESS SWITCH 23

- 7-1. Address Setting of the Remote Control Unit

8. CONNECTING A HOME AUTOMATION DEVICE 24


9. INSTALLATION CHECK SHEET 24

Model Combinations

Combine indoor and outdoor units only as listed below.

Indoor Unit

Outdoor Unit

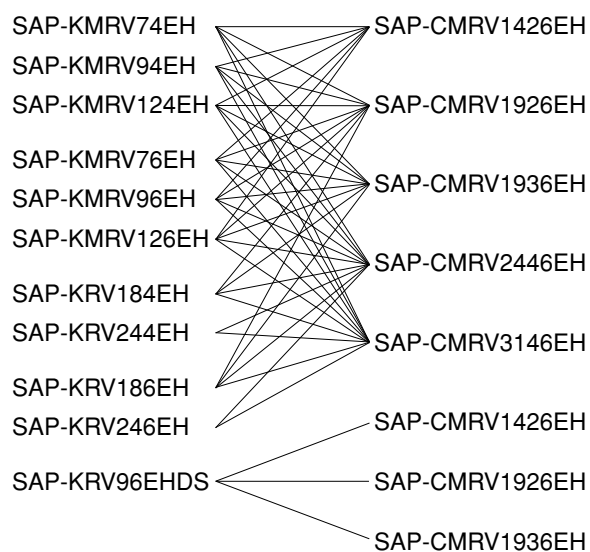

Power Source:
50 Hz, single-phase, 220 – 240 VAC

Combinations of indoor and outdoor units

Connect indoor and outdoor units only in the combinations listed in the catalog or installation manual.



CAUTION

Connecting any other model may result in operation failure and system damage.

Be sure to read the yellow instruction sheet attached to the outdoor unit for models using the new refrigerant R410A.

NOTE

The illustrations are based on the typical appearance of a standard model. Consequently, the shape may differ from that of the air conditioner that you are installing.

English

Español

Français

Deutsch

Italiano

Português

Ελληνικά

IMPORTANT! Please Read Before Starting

This air conditioning system meets strict safety and operating standards. As the installer or service person, it is an important part of your job to install or service the system so it operates safely and efficiently.

For safe installation and trouble-free operation, you must:

- Carefully read this instruction booklet before beginning.
- Follow each installation or repair step exactly as shown.
- Observe all local, state, and national electrical codes.
- Pay close attention to all warning and caution notices given in this manual.



WARNING

This symbol refers to a hazard or unsafe practice which can result in severe personal injury or death.



CAUTION

This symbol refers to a hazard or unsafe practice which can result in personal injury or product or property damage.

If Necessary, Get Help

These instructions are all you need for most installation sites and maintenance conditions. If you require help for a special problem, contact our sales/service outlet or your certified dealer for additional instructions.

In Case of Improper Installation

The manufacturer shall in no way be responsible for improper installation or maintenance service, including failure to follow the instructions in this document.

SPECIAL PRECAUTIONS

WARNING

When Wiring



ELECTRICAL SHOCK CAN CAUSE SEVERE PERSONAL INJURY OR DEATH. ONLY A QUALIFIED, EXPERIENCED ELECTRICIAN SHOULD ATTEMPT TO WIRE THIS SYSTEM.

- Do not supply power to the unit until all wiring and tubing are completed or reconnected and checked.
- Highly dangerous electrical voltages are used in this system. Carefully refer to the wiring diagram and these instructions when wiring. Improper connections and inadequate grounding can cause **accidental injury or death**.
- **Ground the unit** following local electrical codes.
- Connect all wiring tightly. Loose wiring may cause overheating at connection points and a possible fire hazard.
- Install a protective **leakage breaker** depending on the installation location (especially a damp or humid location). If a **leakage breaker** is not installed, electric shock can occur.

When Transporting

Be careful when picking up and moving the indoor and

outdoor units. Get a partner to help, and bend your knees when lifting to reduce strain on your back. Sharp edges or thin aluminum fins on the air conditioner can cut your fingers.

When Installing...

...In a Ceiling or Wall

Make sure the ceiling/wall is strong enough to hold the unit's weight. It may be necessary to construct a strong wood or metal frame to provide added support.

...In a Room

Properly insulate any tubing run inside a room to prevent "sweating" that can cause dripping and water damage to walls and floors.

...In Moist or Uneven Locations

Use a raised concrete pad or concrete blocks to provide a solid, level foundation for the outdoor unit. This prevents water damage and abnormal vibration.

When Connecting Refrigerant Tubing

- Do not add any refrigerant, air, or substance into the refrigeration circuit other than the designated refrigerant (R410A). Adding anything other than the specified refrigerant may cause the pressure to rise excessively in the refrigeration circuit, rupturing the circuit and causing injury or damage.
- Use all-new tubing and flare nuts to make the tubing connections. Using any previous parts (from R22-based systems) may result in damage to the equipment, and may lead to the refrigeration circuit rupturing, causing a serious accident.
- Apply refrigerant lubricant to the matching surfaces of the flare and union tubes before connecting them, then tighten the nut with a torque wrench for a leak-free connection.
- Check carefully for leaks before starting the test run.

When Servicing

- Turn the power OFF at the main power box (mains) before opening the unit to check or repair electrical parts and wiring.
- Keep your fingers and clothing away from any moving parts.
- Clean up the site after you finish, remembering to check that no metal scraps or bits of wiring have been left inside the unit being serviced.



CAUTION

Others

- Ventilate any enclosed areas when installing or testing the refrigeration system. Escaped refrigerant gas, on contact with fire or heat, can produce dangerously toxic gas.
- Confirm upon completing installation that no refrigerant gas is leaking. If escaped gas comes in contact with a stove, gas water heater, electric room heater or other heat source, it can produce dangerously toxic gas.

1. General








This booklet briefly outlines where and how to install the air conditioning system. Please read over the entire set of instructions for the indoor and outdoor units and make sure all accessory parts listed are with the system before beginning.

1-1. Tools Required for Installation (not supplied)

1. Standard screwdriver
2. Phillips head screwdriver
3. Knife or wire stripper
4. Tape measure
5. Carpenter's level
6. Sabre saw or key hole saw
7. Hacksaw
8. Core bits
9. Hammer
10. Drill
11. Tube cutter
12. Tube flaring tool
13. Torque wrench
14. Adjustable wrench
15. Reamer (for deburring)

1-2. Accessories Supplied with Unit

Table 1

Parts	Figure	Q'ty	Parts	Figure	Q'ty	Parts	Figure	Q'ty
Remote control unit		1	Tapping screw		2	Air clean filter*		2
Remote control unit holder		1	Tapping screw		8	Clamp**		1
AAA alkaline battery		2						

Packed in the indoor unit.

* 1 only for KRV96.

** Not applicable for KRV96.

1-3. Optional Copper Tubing Kit

Copper tubing for connecting the outdoor unit to the indoor unit is available in kits which contain the narrow and wide tubing, fittings and insulation. Consult your nearest sales outlet or Air Conditioner workshop.

2. Foamed polyethylene insulation for the specified copper tubes as required to precise length of tubing. Wall thickness of the insulation should be not less than 8 mm.
3. Use insulated copper wire for field wiring. Wire size varies with the total length of wiring. Refer to 3-6. Wiring Instructions for details.

1-4. Type of Copper Tube and Insulation Material

If you wish to purchase these materials separately from a local source, you will need:

1. Deoxidized annealed copper tube for refrigerant tubing as detailed in Table 2.

Cut each tube to the appropriate lengths +30 cm to 40 cm to dampen vibration between units.



CAUTION

Check local electrical codes and regulations before obtaining wire. Also, check any specified instructions or limitations.

Table 2

Model	Narrow Tube		Wide Tube	
	Outer Dia.	Thickness	Outer Dia.	Thickness
KMRV74/94/124	6.35 mm	0.8 mm	9.52 mm	0.8 mm
KMRV76/96/126	6.35 mm	0.8 mm	9.52 mm	0.8 mm
KRV96	6.35 mm	0.8 mm	9.52 mm	0.8 mm
KRV184/186	6.35 mm	0.8 mm	12.70 mm	0.8 mm
KRV244/246	6.35 mm	0.8 mm	15.88 mm	1.0 mm

1-5. Additional Materials Required for Installation

1. Refrigeration (armored) tape
2. Insulated staples or clamps for connecting wire
(See local codes)
3. Putty
4. Refrigeration lubricant
5. Clamps or saddles to secure refrigerant tubing

2. Installation Site Selection

2-1. Indoor Unit



WARNING

To prevent abnormal heat generation and the possibility of fire, do not place obstacles, enclosures and grilles in front of or surrounding the air conditioner in a way that may block air flow.

AVOID:

- direct sunlight.
- nearby heat sources that may affect performance of the unit.
- areas where leakage of flammable gas may be expected.
- placing or allowing any obstructions near the Air Conditioner inlet or outlet.
- installing in rooms that contain instant-on (rapid-start) fluorescent lamps. (These may prevent the Air Conditioner from receiving signals.)
- places where large amounts of oil mist exist.
- installing in locations where there are devices that generate high-frequency emissions.

DO:

- select an appropriate position from which every corner of the room can be uniformly cooled. (High on a wall is best.)
- select a location that will hold the weight of the unit.
- select a location where tubing and drain hose have the shortest run to the outside. (Fig. 1)
- allow room for operation and maintenance as well as unrestricted air flow around the unit. (Fig. 2)
- install the unit within the maximum elevation difference (H1, H2, H3, H4) above or below the outdoor unit and within a total tubing length (L1+L2, L1+L2+L3, L1+L2+L3+L4) from the outdoor unit as detailed in Table 3 and Fig. 3a.


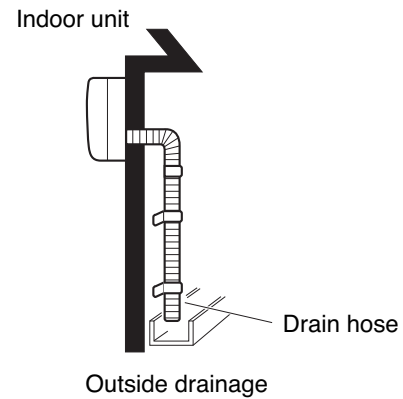


Fig. 1

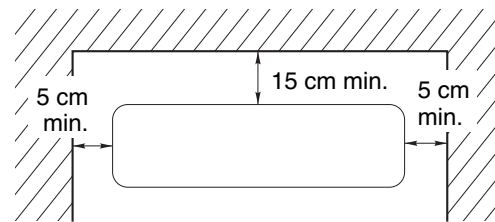

Front View

Fig. 2

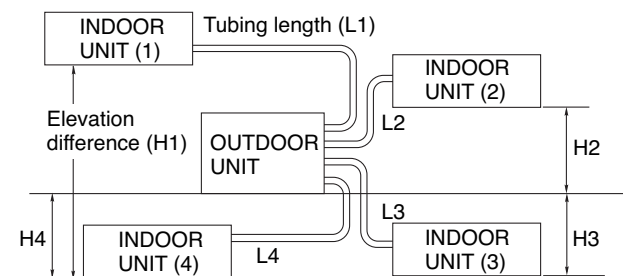


Fig. 3a



CAUTION

For stable operation of the air conditioner, do not install wall-mounted type indoor units less than 1.5 m from floor level.

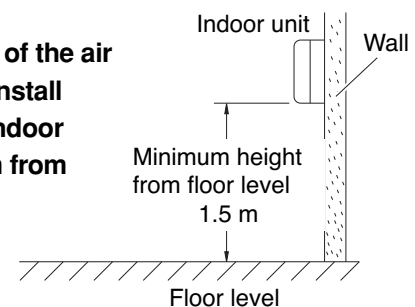


Fig. 3b

- Install the indoor unit more than 1 meter away from any antenna or power lines or connecting wires used for television, radio, telephone, security system, or intercom. Electrical noise from any of these sources may affect operation.
- install in a sturdy manner to avoid increased operating noise.

Table 3

Model	Max. Allowable Tubing Length per unit (m)	Max. Allowable Total Tubing Length at shipment (L1+L2) or (L1+L2+L3) or (L1+L2+L3+L4) (m)	Limit of Total Tubing Length (L1+L2) or (L1+L2+L3) or (L1+L2+L3+L4) (m)	Limit of Elevation Difference (H1, H2, H3, H4) (m)	Required Amount of Additional Refrigerant (g/m)*
CMRV1426	20	30 (L1+L2)	30 (L1+L2)	15	—
CMRV1926	25	45 (L1+L2)	45 (L1+L2)	15	—
CMRV1936	25	45 (L1+L2+L3)	45 (L1+L2+L3)	15	—
CMRV2446	25	45 (L1+L2+L3+L4)	60 (L1+L2+L3+L4)	15	20
CMRV3146	30	45 (L1+L2+L3+L4)	70 (L1+L2+L3+L4)	15	20

* If total tubing length becomes 45 to 60 m (max.) or 45 to 70 m (max.), charge additional refrigerant (R410A) by 20 g/m. No additional charge of compressor oil is necessary.

2-2. Embedding the Tubing and Wiring

- Before beginning embedding installation work, consult fully with agencies or offices related to the building's foundation, construction, electricity, and water.
- Wait to make connections to the embedded portion. Each connection step is described later in this manual.
- Securely cover the end of the embedded tubing to prevent intrusion of dirt or moisture.
- If an embedded tube is to be left for a long time, fill the tube with nitrogen and seal both ends securely. If a tube is left open for an extended time, moisture in the air inside the tubing may condense into water droplets, and lead to water contamination of the refrigerant circuit.
- In order to prevent insulation breakdown and ground faults, do not allow wiring ends to come in contact with rainwater, or be subjected to condensation or dew.
- Apply sufficient thermal insulation to the refrigerant tubing and drain pipes.

3. How to Install the Indoor Unit

3-1. Remove the Rear Panel from the Unit

- (1) Remove and discard the set screw on the rear panel except SAP-KRV96EHDS, SAP-KMRV76EH, SAP-KMRV96EH and SAP-KMRV126EH. (Fig. 6)
- (2) Press the 2 \triangle marks on the frame cover and disengage the stationary tabs from the frame. (Fig. 7)
- (3) Remove the rear panel.

NOTE

Tubing can be extended in 5 or 6 directions as shown in Fig. 8a or 8b. Select the direction you need providing the shortest run to the outside unit.

- When left tubing is to be done, switch the drain hose and drain cap. (For details, refer to "Switching drain hose and drain cap" on page 17 and 18.)

3-2. Make a Hole

- (1) Place the rear panel from the indoor unit on the wall at the location selected. Make sure the panel is horizontal, using a carpenter's level or tape measure to measure down from the ceiling. Wait until after cutting the hole before attaching the rear panel to the wall.
- (2) Determine which side of the unit you should make the hole for tubing and wiring. (Fig. 9a, 9b or 9c)

NOTE

In the case of left-rear tubing, use the measurement points from the edge of the rear panel for precise placement of the hose outlet. (Fig. 9a, 9b or 9c)

- (3) Before making the hole, check carefully that no studs or pipes are directly run behind the spot to be cut.



CAUTION

Also avoid areas where electrical wiring or conduits are located.

The above precautions are also applicable if tubing goes through the wall in any other location.

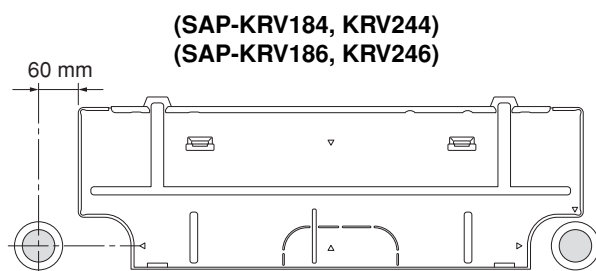


Fig. 9b

(SAP-KMRV74, KMRV94, KMRV124) (SAP-KRV184, KRV244)
(SAP-KRV186, KRV246)

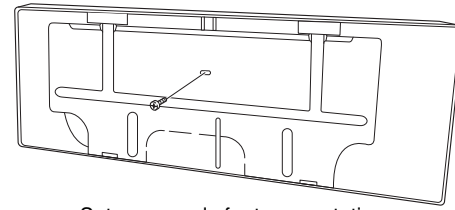


Fig. 6

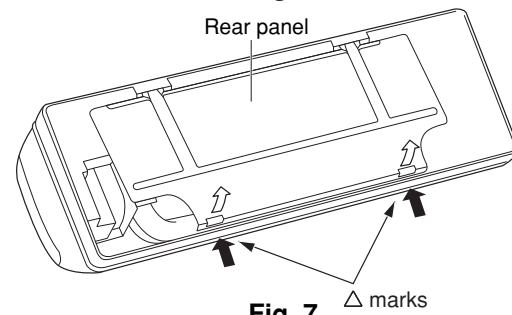


Fig. 7

(SAP-KRV184, KRV244) (SAP-KRV186, KRV246)

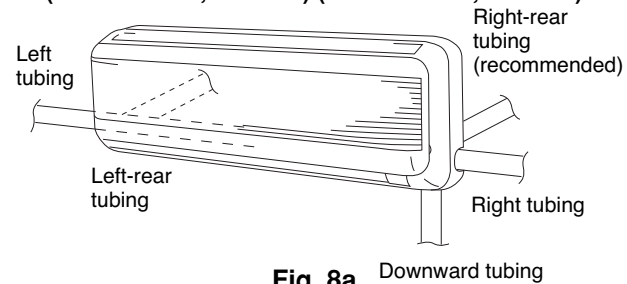


Fig. 8a

(SAP-KMRV74, KMRV94, KMRV124)
(SAP-KMRV76, KMRV96, KMRV126) (SAP-KRV96)

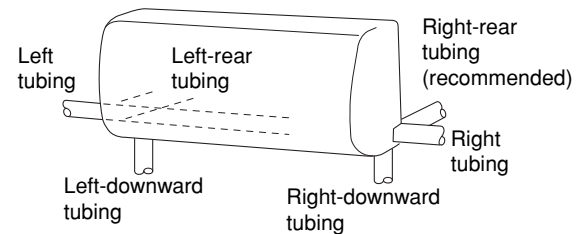


Fig. 8b

(SAP-KMRV74, KMRV94, KMRV124)
(SAP-KMRV76, KMRV96, KMRV126)

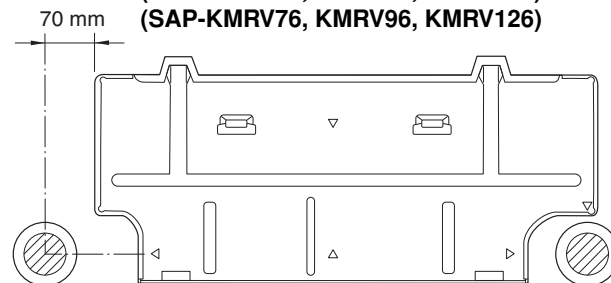


Fig. 9a

(SAP-KRV96)

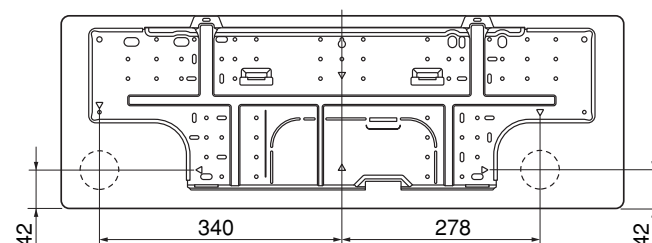


Fig. 9c

- (4) Using a sabre saw, key hole saw or hole-cutting drill attachment, cut a hole in the wall. See Table 4 and Fig. 10.

Table 4

Hole Dia. (mm)	
KMRV74 / KMRV94 / KMRV124 / KRV96 KMRV76 / KMRV96 / KMRV126	KRV184 / KRV244 KRV186 / KRV246
65	80

- (5) Measure the thickness of the wall from the inside edge to the outside edge and cut PVC pipe at a slight angle 6 mm shorter than the thickness of the wall. (Fig. 11)
- (6) Place the plastic cover over the end of the pipe (for indoor side only) and insert the pipe in the wall. (Fig. 12)

3-3. Install the Rear Panel on the Wall

Be sure to confirm that the wall is strong enough to suspend the unit.

See either Item a) or b) below depending on the wall type.

a) If Wooden Wall


- (1) Attach the rear panel to the wall with the 8 screws provided. (Fig. 13a, 13b or 13c)

If you are not able to line up the holes in the rear panel with the beam locations marked on the wall, use rawl plugs or toggle bolts to go through the holes on the panel or drill 5 mm dia. holes in the panel over the stud locations and then mount the rear panel.

- (2) Double check with a carpenter's level or tape measure that the panel is level. This is important to install the unit properly. (Fig. 14)
- (3) Make sure the panel is flush against the wall. Any space between the wall and unit will cause noise and vibration.



b) If Block, Brick, Concrete or Similar Type Wall

Make 4.8 mm dia. holes in the wall. Insert rawl plugs for appropriate mounting screws. (Fig. 15)

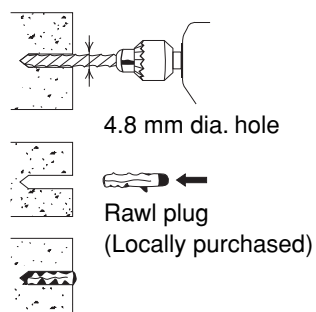
**Fig. 15**

NOTE


Hole should be made at a slight downward slant to the outdoor side.

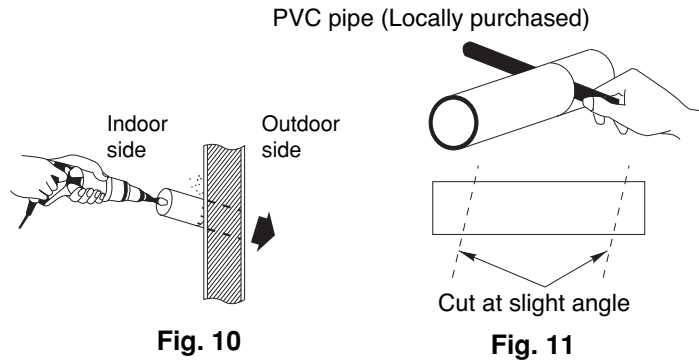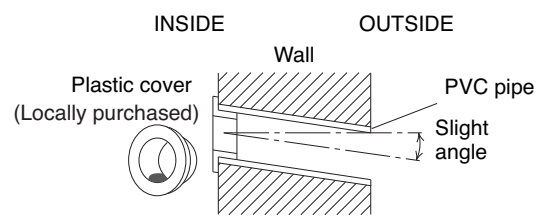**Fig. 10****Fig. 11****Fig. 12**



(SAP-KMRV74, KMRV94, KMRV124)
(SAP-KMRV76, KMRV96, KMRV126)

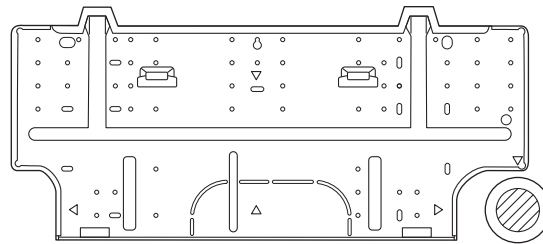**Fig. 13a**

(SAP-KRV184, KRV244) (SAP-KRV186, KRV246)

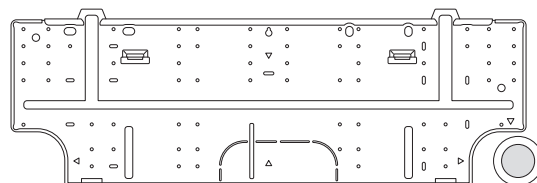**Fig. 13b**

(SAP-KRV96)

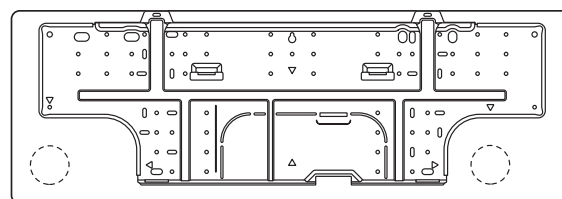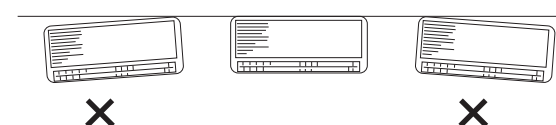**Fig. 13c****Fig. 14**

3-4. Removing and Installing the Grille

3-4-1. Indoor unit types

(SAP-KMRV74EH, KMRV94EH, KMRV124EH)

Basically, these models can be installed and wired without removing the grille. If access to any internal part is needed, follow the steps as given below.



CAUTION

Be sure to wear work gloves during installation to avoid being cut by the sharp aluminum fins of the heat exchanger.

How to remove the grille

- (1) Grasp both ends of the air intake grille, and remove it by opening towards the front and pulling towards you. (Fig. 16a)
- (2) Remove the 2 screws. (Fig. 16b)
- (3) Remove the screw on the right side cover plate and open the cover. (Fig. 17a)
- (4) Take out the thermistor from the grille. (Fig. 17b)
- (5) Pull the lower part of the grille towards you to remove. (Fig. 18a)
- (6) Use a standard screwdriver to push on the tabs to remove the grille. (Fig. 18b)

How to replace the grille

- (1) Reinstall the grille into the lower part while aligning its tabs on the upper part. (Fig. 18b) Insert the tabs in the slots and push the lower part of the grille back into position.
- (2) Make sure that the grille and frame are firmly fitted together by engaging the tabs.
- (3) Attach the thermistor on the grille. (Fig. 17a)
- (4) Close the cover and replace the screw. (Fig. 17a)
- (5) Affix the grille with the 2 previously removed screws. (Fig. 16b)
- (6) Install the air intake grille.
 - (a) Allow the edge of the air intake grille to slide into the top of the indoor unit, and then insert it all the way inside. (Fig. 19a)
 - (b) Press the bottom right and left corners of the air intake grille to attach it to the indoor unit. (Fig. 19b)

NOTE

Attach so that the round pins at the top right and left corners of the air intake grille are inserted into the grooves at the top right and left of the indoor unit.

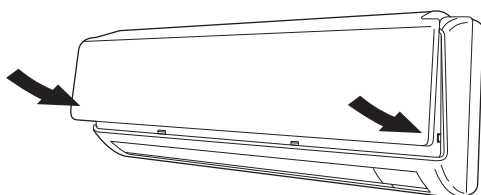


Fig. 19b

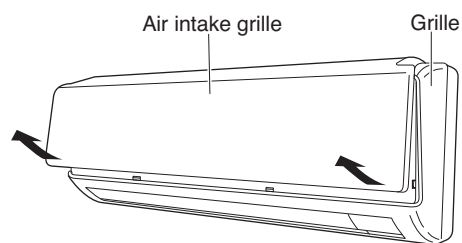


Fig. 16a

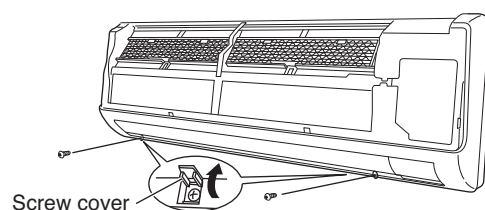


Fig. 16b




Fig. 17a




Fig. 17b

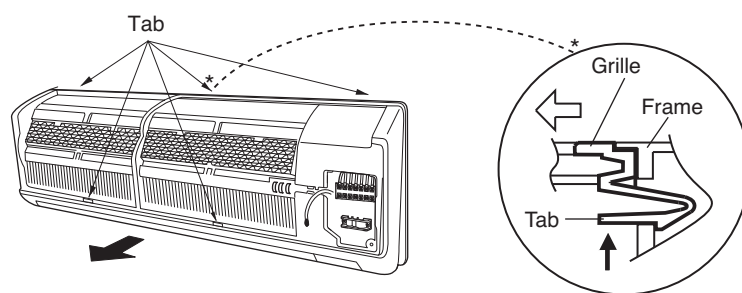


Fig. 18a

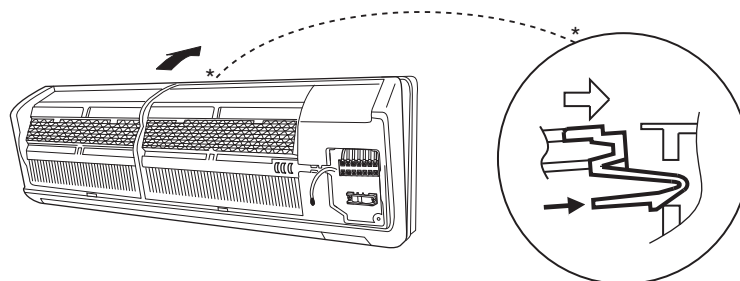


Fig. 18b



Fig. 19a

3-4-2. Indoor unit types (SAP-KRV184EH, KRV244EH)

Basically, these models can be installed and wired without removing the grille. If access to any internal part is needed, follow the steps as given below.

How to remove the grille

- (1) Grasp both ends of the air intake grille, and remove it by opening towards the front and pulling towards you. (Fig. 16a-1)
- (2) Remove the 3 screws. (Fig. 16b-1)
- (3) Remove the screw on the right side cover plate and open the cover. (Fig. 17a-1)
- (4) Take out the thermistor from the grille. (Fig. 17b-1)
- (5) Press the 3 tabs at the top of the grille and the 3 tabs on the front face to separate the grille from the frame. (Fig. 18a-1)
- (6) Pull the grill towards you to remove it.

How to replace the grille

- (1) When installing the grille, place the bottom of the grille into the frame first. (Fig. 18b-1)
Then insert the tabs on the top of the grille and on the front face into the frame.
- (2) Make sure that the grille and frame are firmly fitted together by engaging the tabs.
- (3) Attach the thermistor on the grille. (Fig. 17a-1)
- (4) Close the cover and replace the screw. (Fig. 17a-1)
- (5) Affix the grille with the 3 previously removed screws. (Fig. 16b-1)
- (6) Install the air intake grille.
 - (a) Allow the edge of the air intake grille to slide into the top of the indoor unit, and then insert it all the way inside. (Fig. 19a-1)
 - (b) Press the bottom right and left corners and center of the air intake grille to attach it to the indoor unit. (Fig. 19b-1)

NOTE

Attach so that the round pins at the top right and left corners of the air intake grille are inserted into the grooves at the top right and left of the indoor unit.

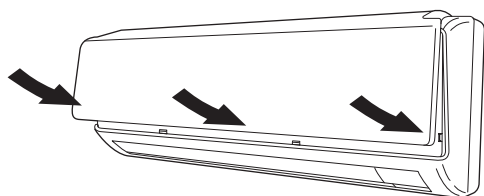


Fig. 19b-1

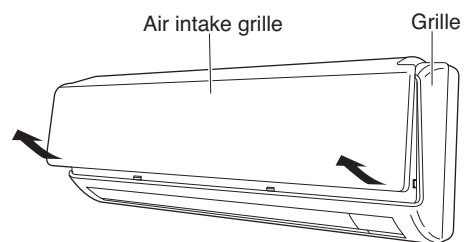


Fig. 16a-1

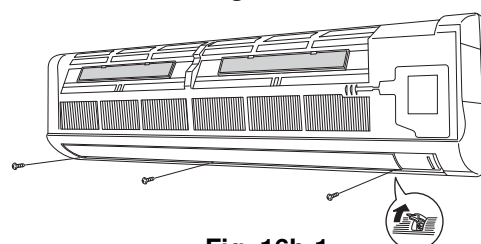


Fig. 16b-1




Fig. 17a-1




Fig. 17b-1

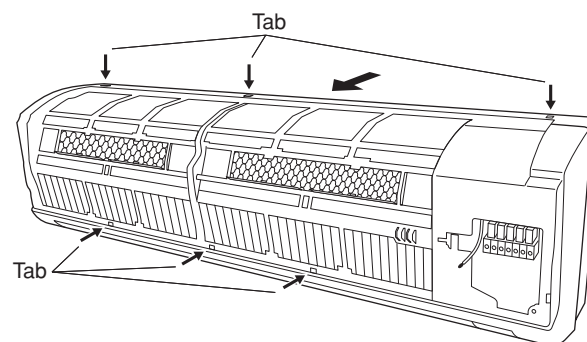


Fig. 18a-1

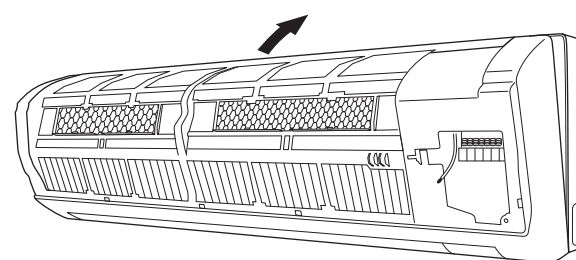


Fig. 18b-1

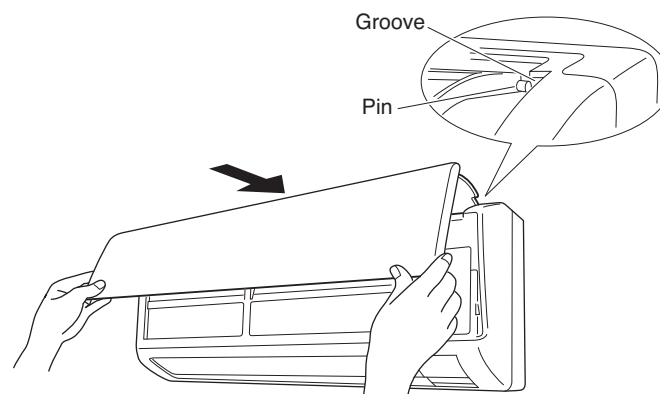


Fig. 19a-1

3-4-3. Indoor unit type (SAP-KRV96EHDS)

Basically, these models can be installed and wired without removing the grille. If access to any internal part is needed, follow the steps as given below.

How to remove the grille

- (1) Open the front panel until it is nearly horizontal, grasp the sections near the front panel arms on both sides, and then pull towards you to remove the front panel. (Fig. 16-2)
- (2) Remove the 3 screws from the frame. Also remove the 2 screws where the screw covers are open. (Fig. 17-2)
- (3) Press the 3 tabs on the top of the grille to disengage them. (Fig. 17-2)
- (4) Pull the grille towards you to remove it. (Fig. 17-2)

How to replace the grille

- (1) Insert the bottom of the grille into the flap, with the flap at a more-or-less horizontal position.
- (2) While aligning both edges of the grille with the frame, move the panel horizontally and insert the top and bottom into the frame.
- (3) Press the air discharge outlet firmly with your hand to ensure no gap exists between the main unit and grille.
- (4) Tighten the 2 screws and close the screw covers. Also tighten the 3 screws of the frame.
- (5) Grasp the sections near the front panel arms on both sides, hold the front panel so that it is nearly horizontal, bring the arm shafts into contact with the top of the grooves on the right and left sides of the air conditioner, and then push firmly until the arm shafts click into place. (Fig. 18-2)
- (6) After closing the front panel, press firmly on the parts indicated by the arrows to securely fasten the panel in place. (Fig. 19-2)

NOTE

Check that no gap exists between the main unit and grille.

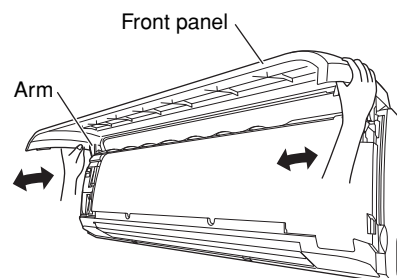


Fig. 16-2

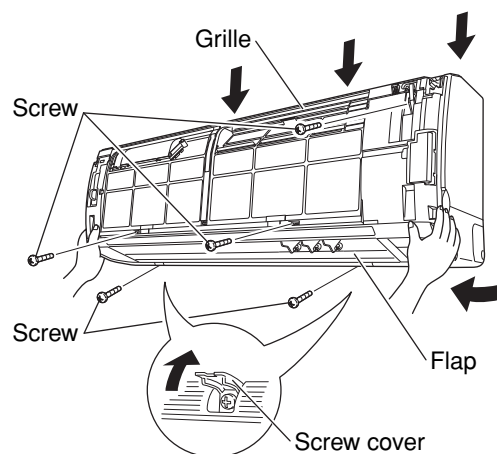


Fig. 17-2

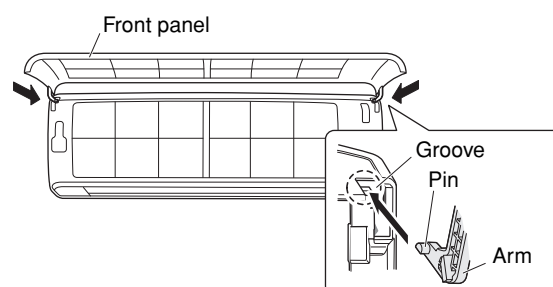


Fig. 18-2

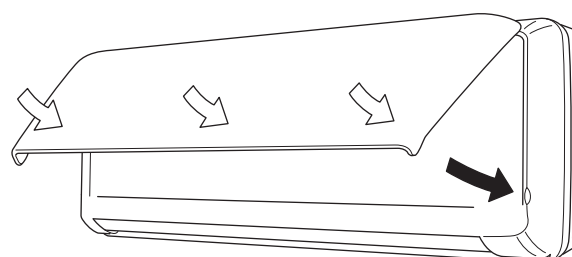


Fig. 19-2

3-4-4. Indoor unit types

(SAP-KMRV76EH, KMRV96EH, KMRV126EH)

Basically, these models can be installed and wired without removing the grille. If access to any internal part is needed, follow the steps as given below.

How to remove the grille

- (1) Open the front panel until it is nearly horizontal, grasp the sections near the front panel arms on both sides, and then pull towards you to remove the front panel. (Fig. 16-3)
- (2) Remove the 2 screws where the screw covers are open. Grasp the grille on both bottom sides, and pull it towards you slightly. (Fig. 17-3)
- (3) Press the 3 tabs on the top of the grille to disengage them. (Fig. 17-3)
- (4) Pull the grille towards you to remove it. (Fig. 17-3)

How to replace the grille

- (1) Insert the bottom of the grille into the frame.
- (2) While aligning both edges of the grille with the frame, move the grille horizontally and insert the top and bottom into the frame.
- (3) Press the grille firmly with your hand to ensure no gap exists between the frame and grille.
- (4) Tighten the 2 screws and close the screw covers.
- (5) Grasp the sections near the front panel arms on both sides, hold the front panel so that it is nearly horizontal, bring the arm shafts into contact with the top of the grooves on the right and left sides of the air conditioner, and then push firmly until the arm shafts click into place. (Fig. 18-3)
- (6) Press the bottom right and left corners of the front panel to attach it to the indoor unit. (Fig. 19-3)

NOTE

Check that no gap exists between the frame and the grille.

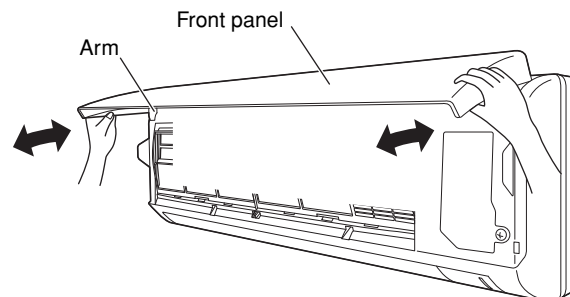


Fig. 16-3

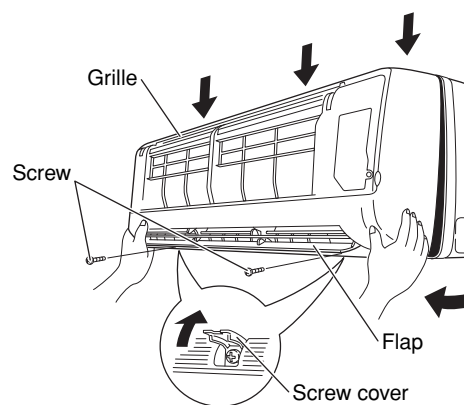


Fig. 17-3

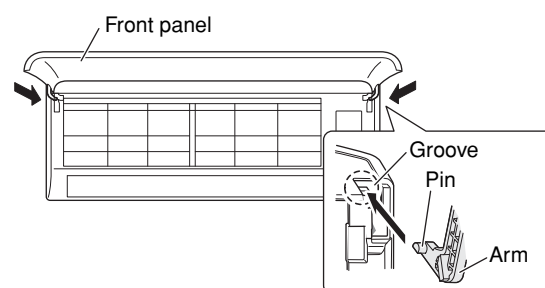


Fig. 18-3

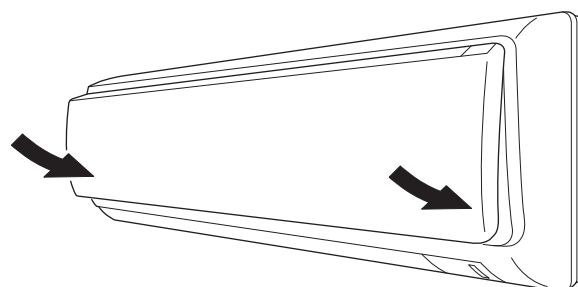


Fig. 19-3

English

3-4-5. Indoor unit types (SAP-KRV186EH, KRV246EH)

Basically, these models can be installed and wired without removing the grille. If access to any internal part is needed, follow the steps as given below.

How to remove the grille

- (1) Open the front panel until it is nearly horizontal, grasp the sections near the front panel arms on both sides, and then pull towards you to remove the front panel. (Fig. 16-4)
- (2) Remove the 3 screws where the screw covers are open. (Fig. 17-4)
- (3) Press the 3 tabs at the top of the grille and the 3 tabs on the front face to separate the grille from the frame. (Fig. 18a-4)
- (4) Pull the grille towards you to remove it. (Fig. 18a-4)

How to replace the grille

- (1) When installing the grille, place the bottom of the grille into the frame first. (Fig. 18b-4) Then insert the tabs on the top of the grille and on the front face into the frame.
- (2) Make sure that the grille and frame are firmly fitted together by engaging the tabs.
- (3) Press the grille firmly with your hand to ensure no gap exists between the frame and grille.
- (4) Tighten the 3 screws and close the screw covers.
- (5) Grasp the sections near the front panel arms on both sides, hold the front panel so that it is nearly horizontal, bring the arm shafts into contact with the top of the grooves on the right and left sides of the air conditioner, and then push firmly until the arm shafts click into place. (Fig. 18c-4)
- (6) After closing the front panel, press firmly on the parts indicated by the arrows to securely fasten the panel in place. (Fig. 19-4)

NOTE

Check that no gap exists between the frame and the grille.

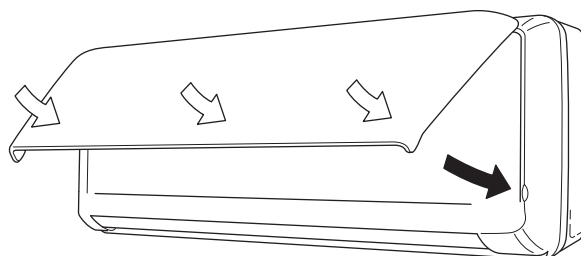


Fig. 19-4

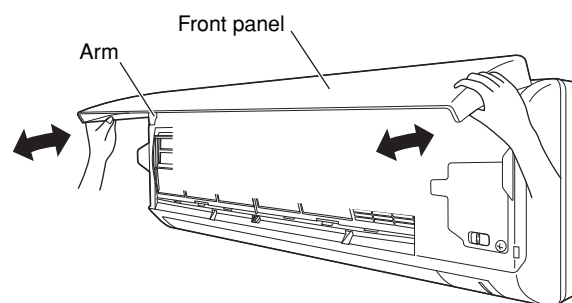


Fig. 16-4

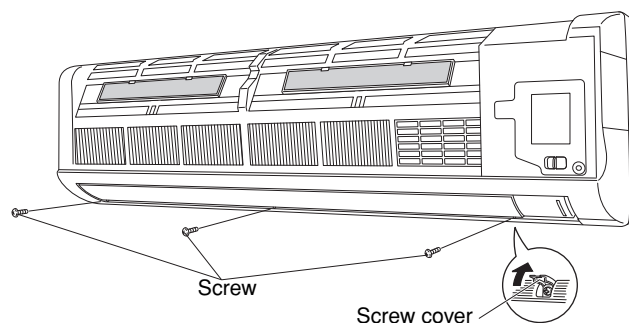


Fig. 17-4

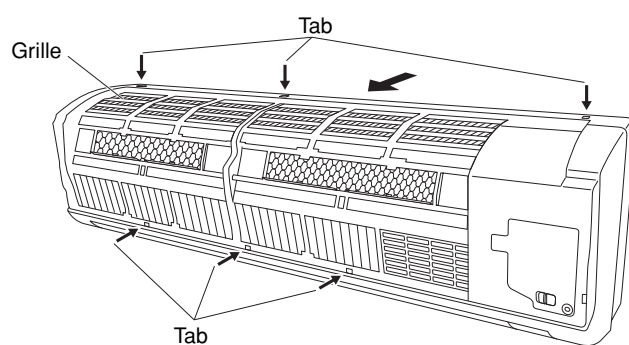


Fig. 18a-4

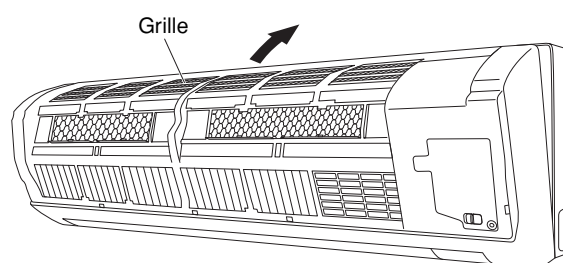


Fig. 18b-4

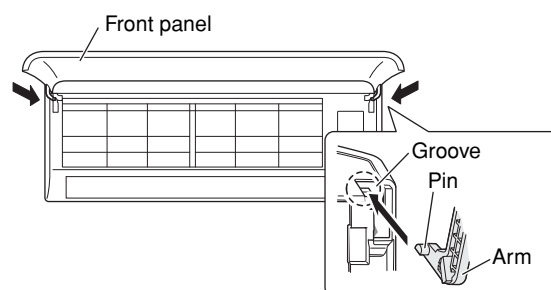


Fig. 18c-4

3-5. Shape the Indoor Side Tubing

(1) Arrangement of tubing by directions

a) Right or left tubing

Cut out the corner of the right/left frame with a hacksaw or the like. (Figs. 20 and 21)

b) Right-rear or left-rear tubing

In this case, the corner of the frame need not be cut.

(2) To mount the indoor unit on the rear panel:

Hang the 2 mounting slots of the unit on the upper tabs of the rear panel. (Fig. 22)

3-6. Wiring Instructions

General precautions on wiring

- (1) Before wiring, confirm the rated voltage of the unit as shown on its nameplate, then carry out the wiring closely following the wiring diagram.
- (2) Provide a power outlet to be used exclusively for each unit, with a power supply disconnect and circuit breaker for overcurrent protection provided in the exclusive line.
- (3) To prevent possible hazard due to insulation failure, the unit must be grounded.
- (4) Each wiring connection must be done tightly and in accordance with the wiring system diagram. Wrong wiring may cause the unit to misoperate or become damaged.
- (5) Do not allow wiring to touch the refrigerant tubing, compressor, or any moving parts of the fan.
- (6) Unauthorized changes in the internal wiring can be very dangerous. The manufacturer will accept no responsibility for any damage or misoperation that occurs as a result of such unauthorized changes.

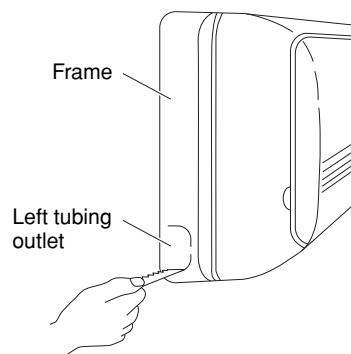


Fig. 20

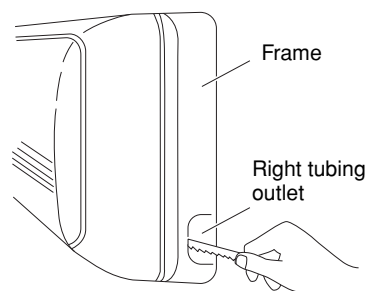


Fig. 21

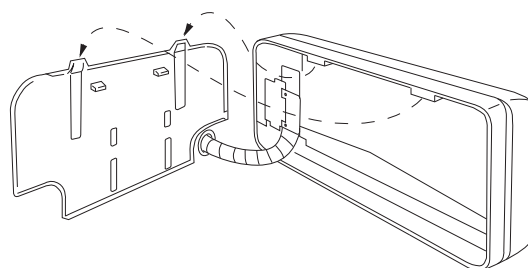


Fig. 22

3-7. Wiring Instructions for Inter-unit Connections

- (1) Grasp both ends of the air intake grille, and remove it by opening towards the front and pulling towards you.
- (2) Remove the screw on the right side cover plate and open the cover. (Fig. 24a, 24b, 24c or 24d)
- (3) Insert the inter-unit wiring into the through-the-wall PVC pipe. Lead the power wiring into the room allowing approx. 25 cm to extend from the wall face. (Fig. 25)
- (4) Route the inter-unit wiring from the back of the indoor unit and pull it towards the front for connection. (Fig. 26a, 26b, 26c or 26d)
- (5) Connect the inter unit wiring to the corresponding terminals on the terminal plate (Fig. 26a, 26b, 26c or 26d) while referring to the wiring diagram.
- (6) Be sure to secure the wiring with the provided clamp.

NOTE

When closing the air intake grille, press the bottom right and left corners and center. (Fig. 27)

Please refer to "How to replace the grille" on page 8, 9, 10, 11 or 12 for installing the air intake grille.

(SAP-KMRV74, KMRV94, KMRV124)
(SAP-KRV184, KRV244)

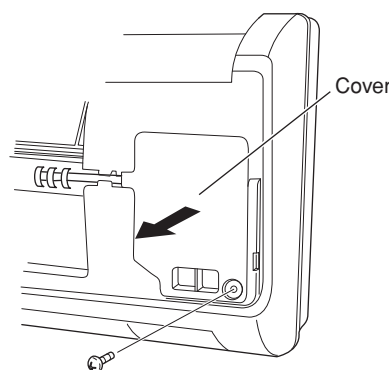


Fig. 24a

(SAP-KRV96)

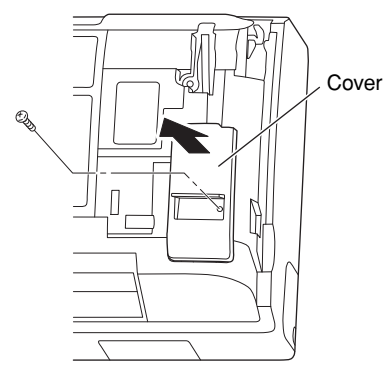


Fig. 24b

(SAP-KMRV76, KMRV96, KMRV126)

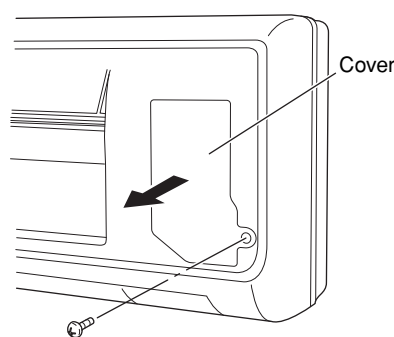


Fig. 24c

(SAP-KRV186, KRV246)

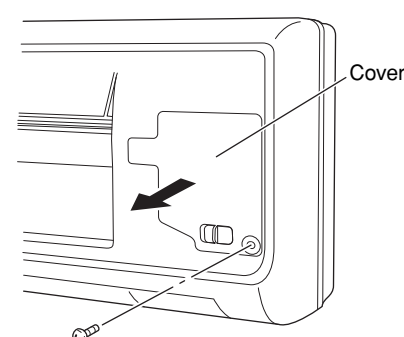


Fig. 24d

(SAP-KMRV74, KMRV94, KMRV124)
(SAP-KRV184, KRV244)

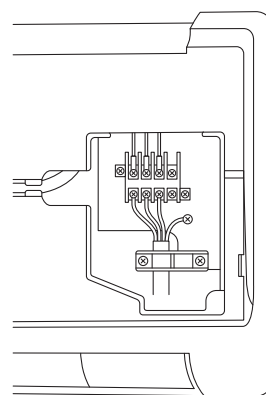


Fig. 26a

(SAP-KRV96)

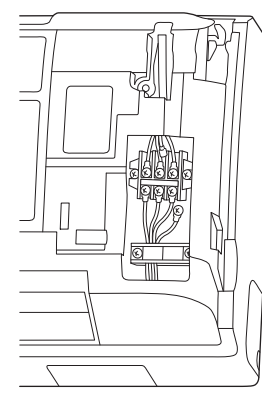


Fig. 26b

(SAP-KMRV76, KMRV96,
KMRV126)

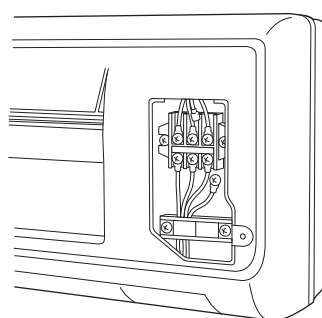


Fig. 26c

(SAP-KRV186, KRV246)

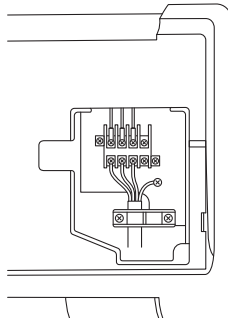


Fig. 26d

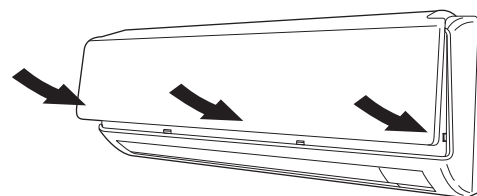


Fig. 27

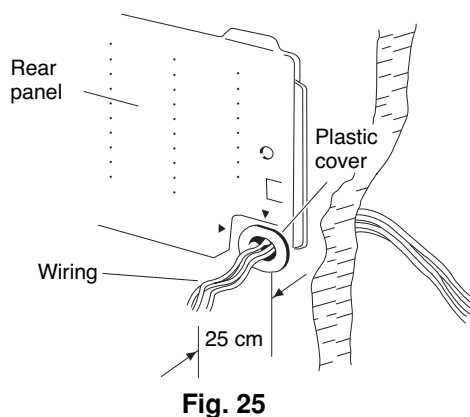


Fig. 25

**WARNING**

Loose wiring may cause the terminal to overheat or result in unit malfunction. A fire hazard may also exist. Therefore, be sure all wiring is tightly connected.

When connecting each power wire to the corresponding terminal, follow the instructions "How to connect wiring to the terminal" and fasten the wire securely tight with the fixing screw of the terminal plate.

How to connect wiring to the terminal**a) For Indoor Unit**






- (1) Cut the wire end with a cutting pliers, then strip the insulation to expose the wire about 7 mm. See the label (Fig. 28) near the terminal plate.
- (2) Using a screwdriver, loosen the terminal screw on the terminal plate.
- (3) Insert the wire and tighten the terminal screw completely using a screwdriver.

b) For Outdoor Unit**■ For solid core wiring (or F-cable)**

- (1) Cut the wire end with a cutting pliers, then strip the insulation to expose the solid wire about 25 mm. (Fig. 29)
- (2) Using a screwdriver, remove the terminal screw(s) on the terminal plate.
- (3) Using the pliers, bend the solid wire to form a loop suitable for the terminal screw.
- (4) Shape the loop wire properly, place it on the terminal plate and fix it securely with the removed terminal screw using a screwdriver.

■ For stranded wiring

- (1) Cut the wire end with a cutting pliers, then strip the insulation to expose the stranded wiring about 10 mm and tightly twist the wire ends. (Figs. 30 and 31)
- (2) Using a screwdriver, remove the terminal screw(s) on the terminal plate.
- (3) Using a ring connector fastener or pliers, securely clamp each stripped wire end with a ring connector. (Fig. 30)
- (4) Place the ring connector wire, and replace and tighten the removed terminal screw using a screwdriver. (Fig. 32)

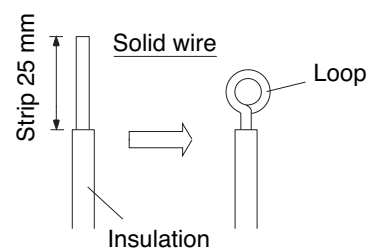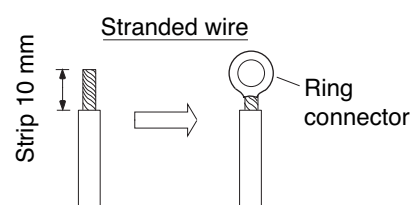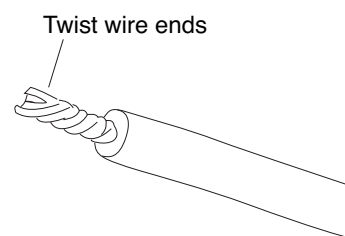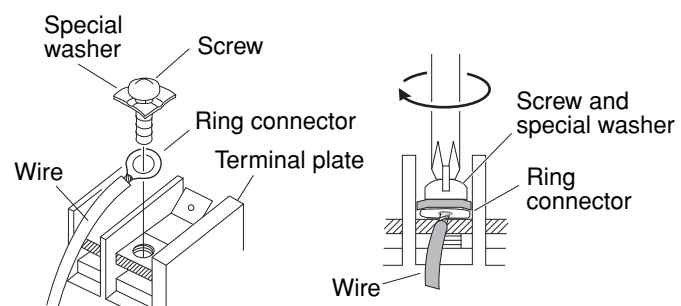**Fig. 28****Fig. 29****Fig. 30****Fig. 31****Fig. 32**

3-8. Mounting

- (1) To install the indoor unit, mount the indoor unit onto the 2 tabs on the upper part of the rear plate.
- (2) Hold down the air discharge outlet and press the lower part of the indoor unit until it clicks to securely fasten to the 2 tabs on the lower part of the rear plate. (Fig. 33)

NOTE

For tubing, choose either the right or left tubing direction and follow the steps below. This work can be made easier by placing padding material (such as styrofoam) at the rear right side of the indoor unit. (Fig. 34a) Or extend the support on the back of the indoor unit as a stand to make your work easier. (Fig. 34b)

■ Right-side tubing

- (1) Shape the refrigerant tubing so that it can easily go into the wall hole. (Fig. 35a or 35b)
- (2) Push the wiring, refrigerant tubing, and drain hose through the hole in the wall. Adjust the indoor unit so it is securely seated on the rear panel. (Fig. 36)
- (3) Carefully bend the tubing (if necessary) to run along the wall in the direction of the outdoor unit and then tape as far as the fittings. (See Caution on page 10 or 15 in the outdoor unit installation manual.) The drain hose should come straight down the wall to a point where water runoff won't stain the wall.
- (4) Connect the refrigerant tubing to the outdoor unit. (After performing a leak test on the connecting part, insulate it with the tubing insulation. (Fig. 37)) Also, refer to Section 3-6. Tubing connections in the outdoor unit installation manual.
- (5) Assemble the refrigerant tubing, drain hose, and inter-unit wiring as shown in Fig. 37.

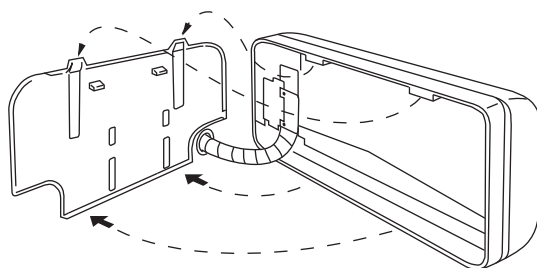


Fig. 36

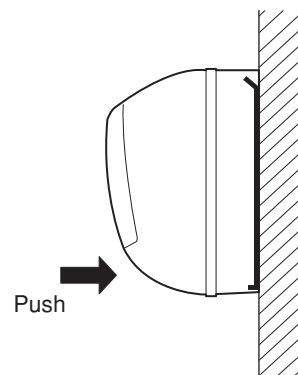


Fig. 33

(SAP-KMRV74, KMRV94, KMRV124)
(SAP-KMRV76, KMRV96, KMRV126)
(SAP-KRV184, KRV244)
(SAP-KRV186, KRV246)

(SAP-KRV96)



Fig. 34a

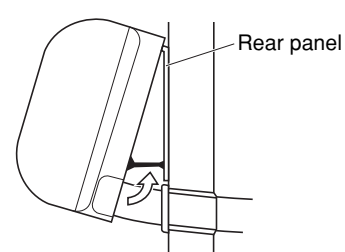


Fig. 34b

(SAP-KMRV74, KMRV94, KMRV124)
(SAP-KMRV76, KMRV96, KMRV126)
(SAP-KRV184, KRV244)
(SAP-KRV186, KRV246)

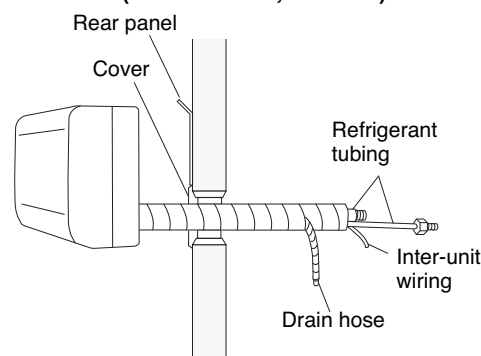


Fig. 35a

(SAP-KRV96)

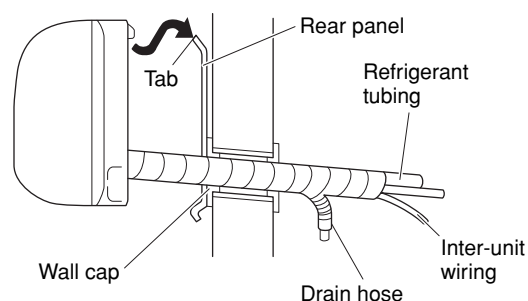


Fig. 35b

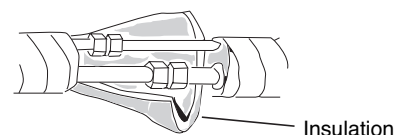


Fig. 37

■ Left-side tubing

(SAP-KMRV74EH, KMRV94EH, KMRV124EH, KMRV76EH, KMRV96EH, KMRV126EH, KRV184EH, KRV244EH, KRV186EH, KRV246EH)

- (1) Lead the tubing and drain hose through the wall, allowing sufficient length for connection. Then bend the tubing using a tube bender to make the attachment. (Fig. 38a)
- (2) Switch the drain hose and drain cap.

Switching drain hose and drain cap

- (a) Locate the drain hose and the drain cap. (Fig. 39a)
- (b) Remove the screws fastening the drain hose on the right side, and pull out the drain hose to remove it. (Fig. 39a)
- (c) Apply moderate force to pull off the drain cap on the left side. (If you cannot pull it off by hand, use a long-nose pliers.)
- (d) Reattach the drain hose to the left side and the drain cap to the right side. (Fig. 40a)

Drain hose

Slide the drain hose fully onto the drain pan outlet until the drain hose edge is pushed into the insulation. Check that the screw holes in the drain bracket and the drain pan outlet are aligned and securely in contact, then fasten them with the screw. (After attaching the drain hose, check that it is attached securely.) (Fig. 40c)

Drain cap

Use a Phillips screwdriver to push the drain cap in firmly. (If it is difficult to push in, wet the cap with water first.)

- (3) Install the indoor unit on the rear panel.
- (4) Connect the tubing and wiring led inside from outdoors.
- (5) After completing a leak test, bundle the tubing together with armoring tape and store it inside the tubing storage area at the back of the indoor unit and hold it with clamps. (Figs. 40a and 41a)

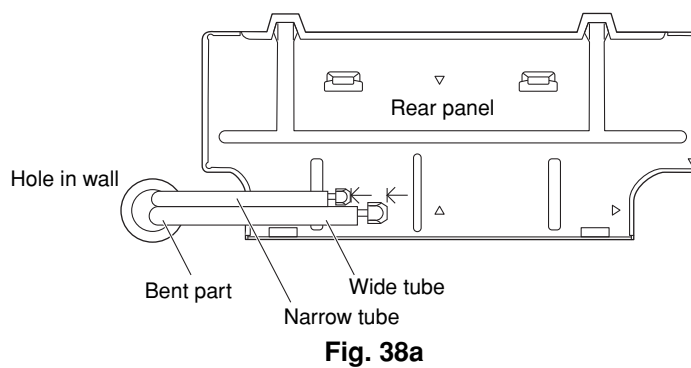


Fig. 38a

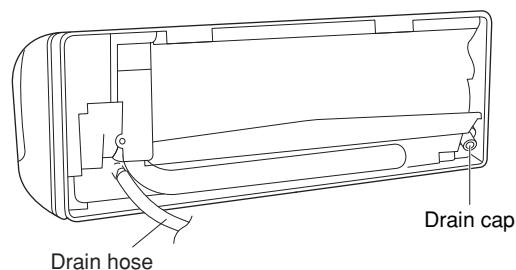


Fig. 39a

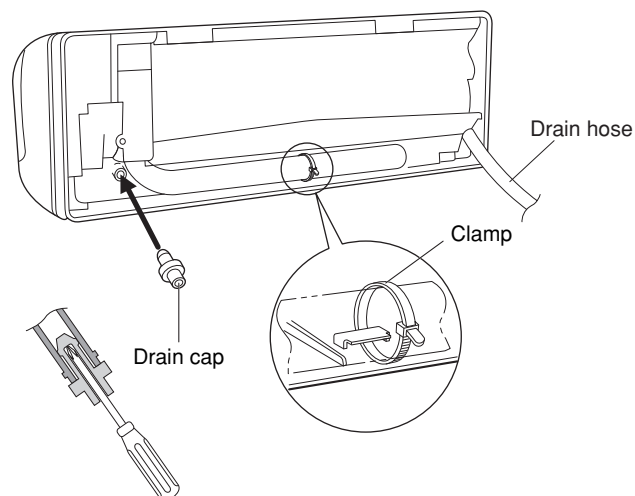


Fig. 40a

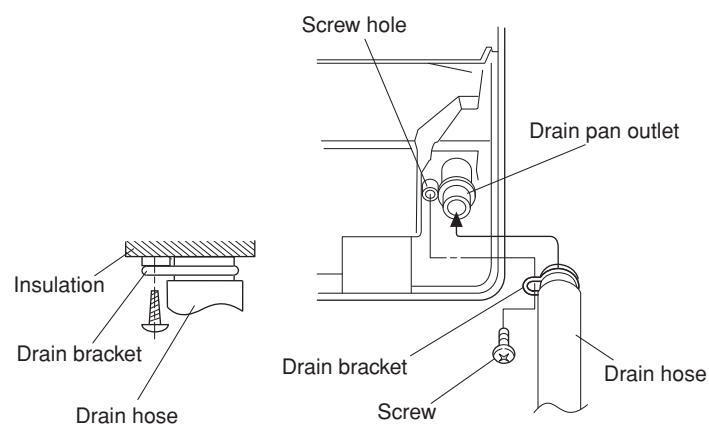


Fig. 40c

Fig. 40b

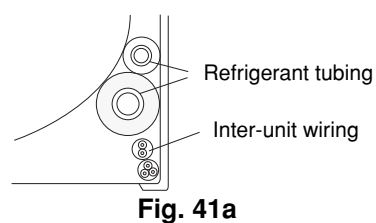


Fig. 41a

English

■ Left-side tubing (SAP-KRV96EHDS)

- (1) Lead the tubing and drain hose through the wall, allowing sufficient length for connection. Then bend the tubing using a tube bender to make the attachment. (Fig. 38b)

- (2) Switch the drain hose and drain cap.

Switching drain hose and drain cap

- (a) Grasp the corners of the bottom left and right indoor unit covers, and press down on the bottom while lifting each cover up to remove it. (Fig. 39b)
- (b) Locate the drain hose and the drain cap. (Fig. 39c)
- (c) When disconnecting the drain hose, remove the drain fitting from the stopper, then check the position of the drain fitting on the end of the hose, and turn the hose while pulling to remove it. (Fig. 39d)
- (d) Screw the drain hose all the way inside. Turn the hose so that the protruding part of the drain fitting comes below the stopper as shown in the figure. It will be easy to insert when water is added. (Fig. 39d)
- (e) Align the tabs of the removed cover with the grille tabs, and then lower the cover to install it.

Drain cap

Use a Phillips screwdriver to push the drain cap in firmly. (If it is difficult to push in, wet the cap with water first.)

- (3) Install the indoor unit on the rear panel.
- (4) Connect the tubing and wiring led inside from outdoors.
- (5) After completing a leak test, bundle the tubing together with armoring tape and store it inside the tubing storage area at the back of the indoor unit and hold it with clamps. (Figs. 40d and 41b)

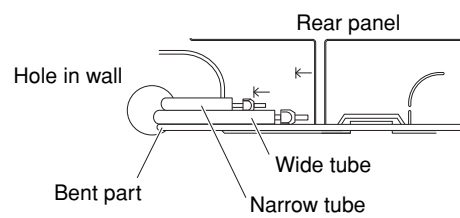


Fig. 38b




Fig. 39b

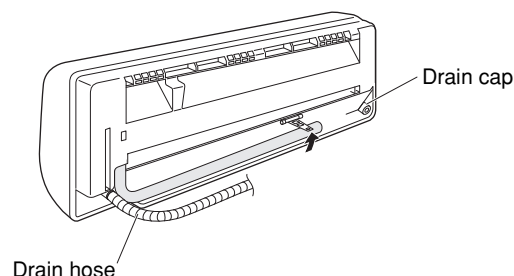


Fig. 39c

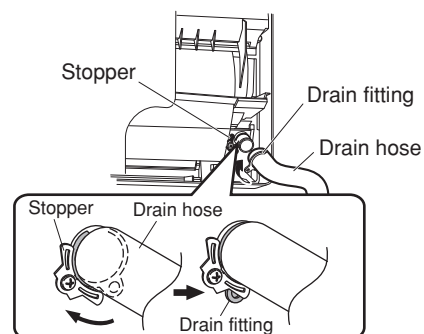


Fig. 39d

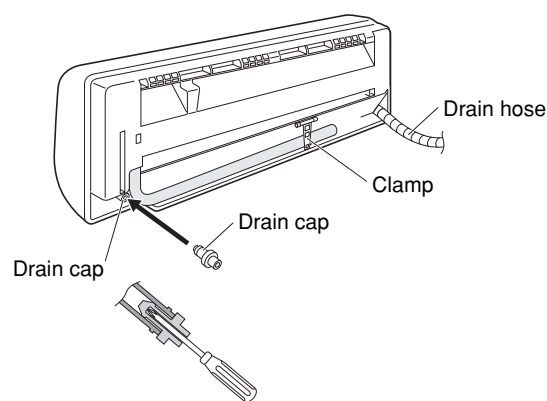


Fig. 40d

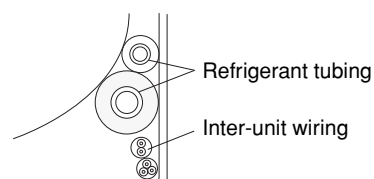


Fig. 41b

To unmount indoor unit

Press the 2 △ marks on the lower part of the indoor unit and unlatch the tabs. Then lift the indoor unit and unmount. (Fig. 42)

3-9. Drain Hose

- The drain hose should be slanted downward to the outdoors. (Fig. 43)
- Never form a trap in the course of the hose.
- If the drain hose will run in the room, insulate the hose with insulation* so that chilled condensation will not damage furniture or floors. (Fig. 44)

* Foamed polyethylene or its equivalent is recommended.



WARNING

Do not supply power to the unit or operate it until all tubing and wiring to the outside unit are completed.



Risk of Electric Shock

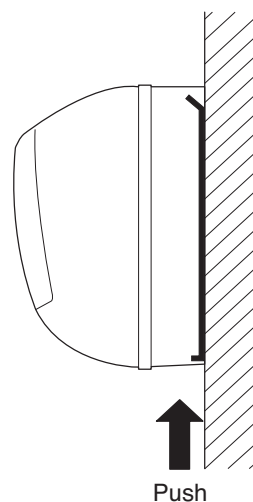


Fig. 42




Fig. 43


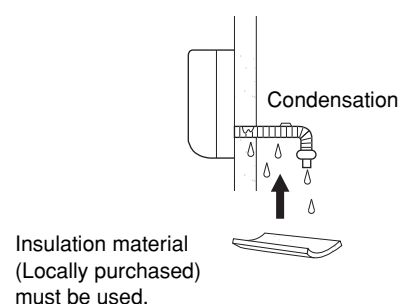


Fig. 44

4. Multiple Switch on the Remote Control Unit Indoor Unit Types (SAP-KRV184EH, KRV244EH) (SAP-KRV186EH, KRV246EH) (SAP-KRV96EHDS)

S/M (Single/Multiple switch)

- Initially, the S/M switch is set to S (Single).
- Set this switch to M (Multiple) for multiple operation.
- Always press ACL button by a thin object such as the tip of a pen after setting the S/M switch.

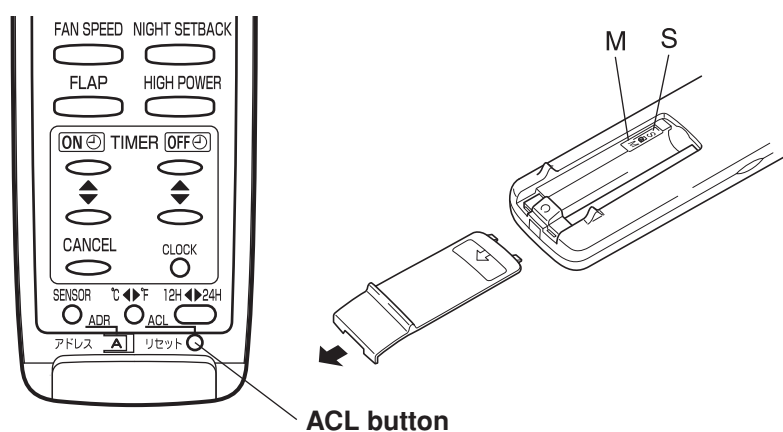

- Slide the cover in the direction indicated by the arrow and remove it.
- Use a thin object such as the tip of a pen to press the ACL button.

5. How to Test Run the Air Conditioner

■ For indoor unit types

(SAP-KMRV74EH, KMRV94EH, KMRV124EH,
KRV184EH, KRV244EH)

English

After turning on the power of the air conditioner, use the remote controller and follow the steps below to conduct the test run.

- (1) Set the remote controller in Test Run mode. (Fig. 59a)
 - a) Press and hold the ION button and the 1HR. TIMER button.
 - b) Then press and hold the ACL (Reset) button with a pointed object such as the tip of a pen. After 5 seconds, release the ACL button first.
 - c) Then release the ION and 1HR. TIMER buttons.
 - d) ✱ appears and "oP-1" blinking in the remote controller clock display area. (Fig. 59b)
- (2) Start Cooling mode test run by pressing the ON/OFF operation button of the remote controller. (Fig. 59a)
 - This starts the fan producing uncooled forced air with the 4 indicator lamps (OPERATION lamp, TIMER lamp, QUIET lamp, and ION lamp) on the main unit blinking. (Fig. 60)
 - After 3 minutes, the system shifts into cooling operation, and cool air will start to be felt. Cooling mode test run is unaffected by the room temperature.
- (3) Press the ON/OFF operation button of the remote controller again to stop the test run. (Fig. 59a)
- (4) Finally press the ACL (Reset) button of the remote controller to release it from Test Run mode to return to normal mode. (Fig. 59a)
 - "✱" and "oP-1" will disappear from the remote controller clock display area.

IMPORTANT

After the test run is completed, be sure to press the ACL (Reset) button to return to normal mode. The air conditioner will not operate correctly if this is not done.

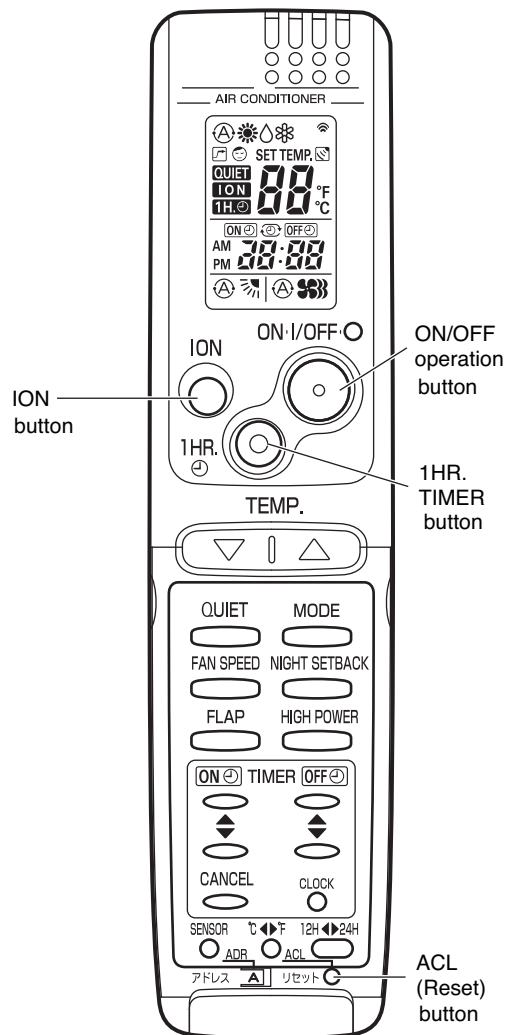


Fig. 59a




Fig. 59b

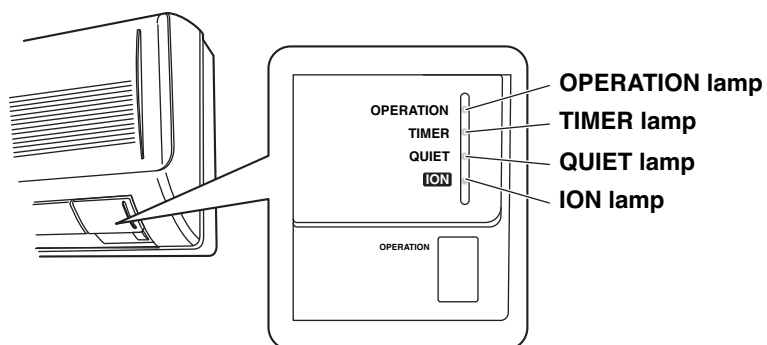


Fig. 60

■ For indoor unit type

(SAP-KMRV76EH, KMRV96EH, KMRV126EH)

(SAP-KRV96EHDS)

(SAP-KRV186EH, KRV246EH)

After turning on the power of the air conditioner, use the remote controller and follow the steps below to conduct the test run.

- (1) Set the remote controller in Test Run mode. (Fig. 59a-1)
 - a) Press and hold the QUIET button and the 1HR. TIMER button.
 - b) Then press and hold the ACL (Reset) button with a pointed object such as the tip of a pen. After 5 seconds, release the ACL button first.
 - c) Then release the QUIET and 1HR. TIMER buttons.
 - d) ※ appears and "oP-1" blinking in the remote controller clock display area. (Fig. 59b-1)
- (2) Start Cooling mode test run by pressing the ON/OFF operation button of the remote controller. (Fig. 59a-1)
 - This starts the fan producing uncooled forced air with the 3 indicator lamps (OPERATION lamp, TIMER lamp, and LED CLEAN lamp) on the main unit blinking. (Fig. 59c-1 or 59c-2)
 - After 3 minutes, the system shifts into cooling operation, and cool air will start to be felt. Cooling mode test run is unaffected by the room temperature.
- (3) Press the ON/OFF operation button of the remote controller again to stop the test run. (Fig. 59a-1)
- (4) Finally press the ACL (Reset) button of the remote controller to release it from Test Run mode to return to normal mode. (Fig. 59a-1)
 - "※" and "oP-1" will disappear from the remote controller clock display area.

IMPORTANT

After the test run is completed, be sure to press the ACL (Reset) button to return to normal mode. The air conditioner will not operate correctly if this is not done.

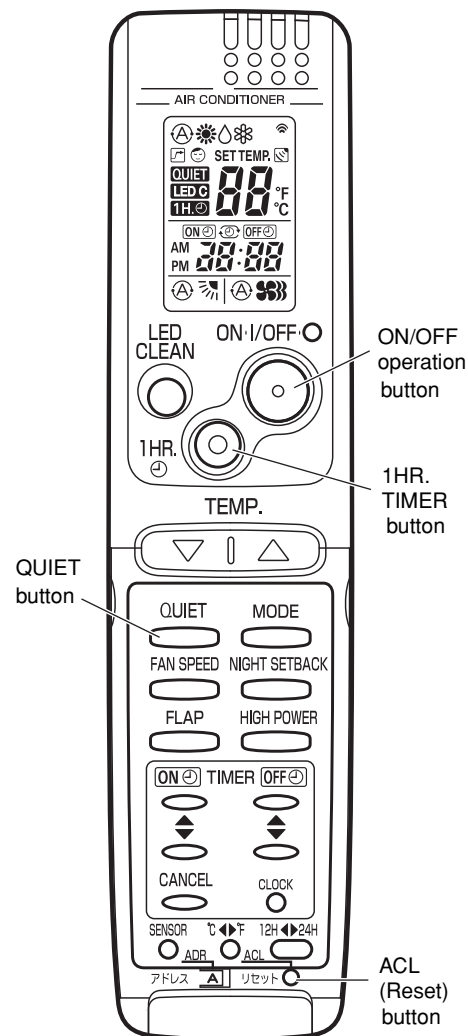


Fig. 59a-1




Fig. 59b-1

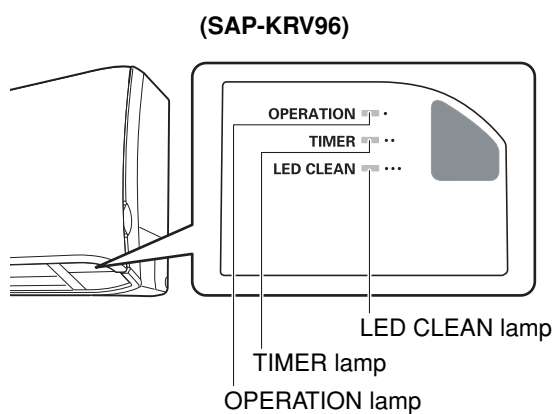


Fig. 59c-1

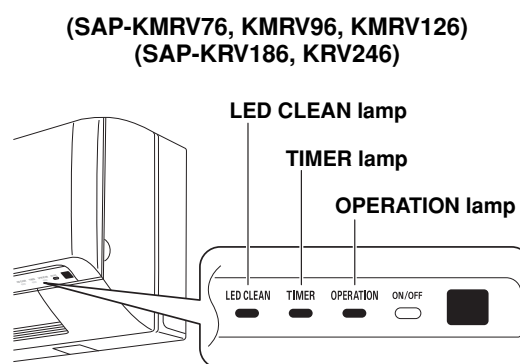


Fig. 59c-2

6. Remote Control Unit Installation Position


The remote control unit can be operated from either a non-fixed position or a wall-mounted position.

To ensure that the air conditioner operates correctly, do not install the remote control unit in the following places:

- In direct sunlight
- Behind a curtain or other place where it is covered
- More than 8 m away from the air conditioner
- In the path of the air conditioner's airstream
- Where it may become extremely hot or cold
- Where it may be subject to electrical or magnetic interference
- Where there is an obstacle between the remote control unit and the air conditioner (since a check signal is sent from the remote control unit every 5 minutes)

6-1. Mounting on a Wall

Before mounting the remote control unit, press the ON/OFF operation button at the mounting location to make sure that the air conditioner operates from that location. The indoor unit should make a beeping sound to indicate that it has received the signal.

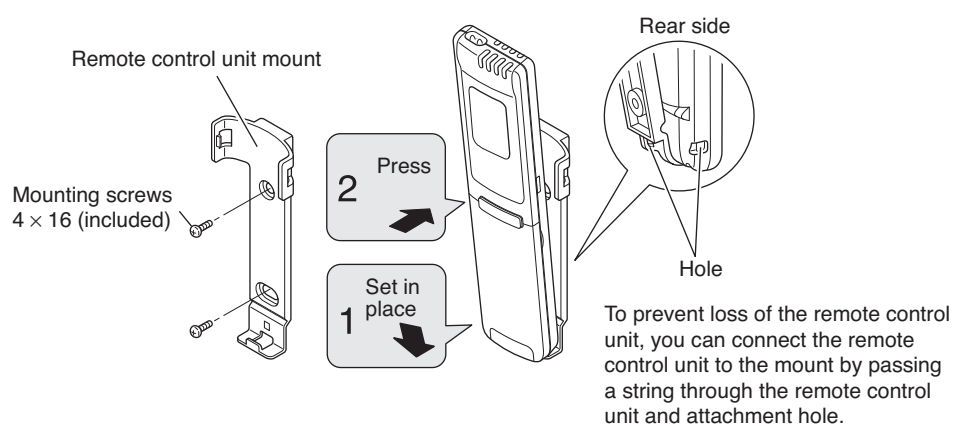

To take out the remote control unit, pull it forward.

Fig. 61

7. Address Switch

7-1. Address Setting of the Remote Control Unit

The address can be set in order to prevent interference between remote controllers when 2 indoor units are installed near each other. The address is normally set to "A." To set a different address, it is necessary to change the address on the second remote controller.

NOTE

Once changed, you cannot restore the original address setting of the air conditioner.

- (1) Switch on the power source.
- (2) Break the address-setting tab marked "A" on the second remote controller to change the address (Fig. 62). When the tab is removed, the address is automatically set to B (Fig. 63).
- (3) **(SAP-KMRV74EH, KMRV94EH, KMRV124EH, KRV184EH, KRV244EH)**
Press and hold the remote controller ION button and 1HR. TIMER button. Then, press and hold the ACL (Reset) button with a pointed object such as the tip of a pen. After 5 seconds, release the ACL button first, then release the ION and 1HR. TIMER buttons. "oP-1" (Test Run) appears, blinking in the remote controller clock display area.

(SAP-KMRV76EH, KMRV96EH, KMRV126EH, KRV96EHDS, KRV186EH, KRV246EH)

Press and hold the remote controller QUIET button and 1HR. TIMER button. Then, press and hold the ACL (Reset) button with a pointed object such as the tip of a pen. After 5 seconds, release the ACL button first, then release the QUIET and 1HR. TIMER buttons. "oP-1" (Test Run) appears, blinking in the remote controller clock display area.

- (4) Each time the 1HR. TIMER button is pressed, the display changes as shown below.
Press this button 2 times to change the display to "oP-7" (address setting).
(Fig. 64a or 64b)

oP-1 Test run mode
↓
oP-3 Selfdiagnostic mode
↓
oP-7 Address setting mode

- (5) "oP-7" has now been selected for address setting.
- (6) Press the ON/OFF operation button on the remote controller. (Fig. 64a or 64b) Check that the "beep" signal-received sound is heard from the second indoor unit (approximately 5 times). The sound you hear is the signal that the remote controller address has been changed.
- (7) Finally press the remote controller ACL (Reset) button to cancel the blinking "oP-7" display.
(Fig. 64a or 64b)

Changing of the second remote controller address is now completed.

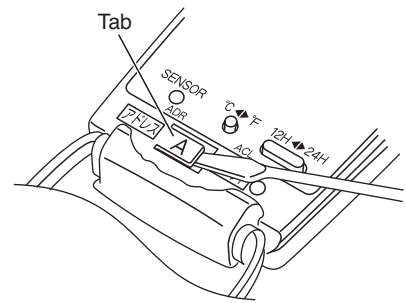


Fig. 62

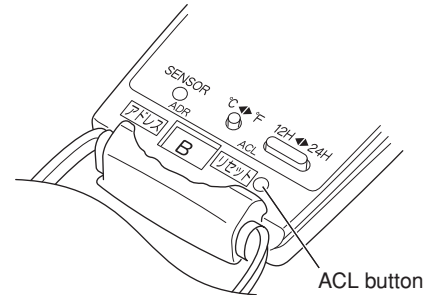


Fig. 63

(SAP-KMRV74, KMRV94, KMRV124, KRV184, KRV244)

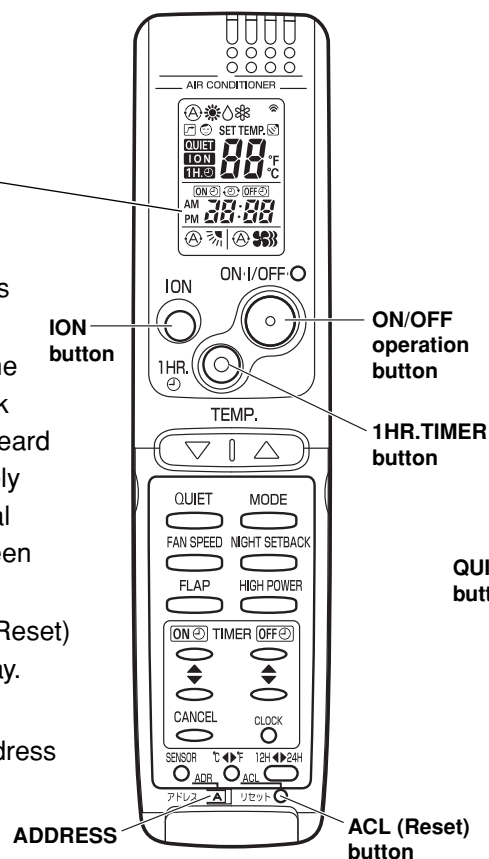


Fig. 64a

(SAP-KMRV76, KMRV96, KMRV126, KRV96, KRV186, KRV246)


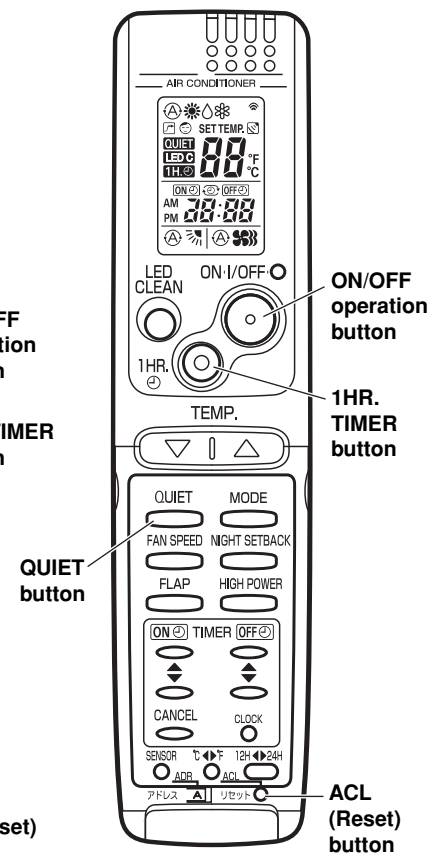


Fig. 64b



8. Connecting a Home Automation Device

The HA (white) 4P terminal is located on the indoor unit PCB. If a HA device will be used, connect it to this terminal.

Also, refer to Section 9. Electric Wiring Diagram in the outdoor unit installation manual.

English

9. Installation Check Sheet

- ☐ The strength of the installation location is sufficient to support the Air Conditioner weight.
- ☐ The indoor and outdoor units are installed level and vertically.
- ☐ The power and voltage are as specified.
- ☐ Inter-unit cables are securely inserted into the terminal block.
- ☐ Inter-unit cables are securely fixed.
- ☐ The power cord and inter-unit cables are not connected anywhere along their paths.
- ☐ The ground wire is securely connected.
- ☐ Thermal insulation has been applied to the tubing connections.
- ☐ Drain connections are secure and water drains properly.
- ☐ Putty has been used to close the hole in the wall.
- ☐ Remote controller signals are being positively received.

